


- NOTES:**
1. CONDUITS FOR GAS, WATER, SEWER AND TELECOM SERVICES TO BE LAID WITHIN THE SUBGRADE
  2. SERVICE CONDUITS TO BE LAID AT A GRADE OF 1 IN 100 FALLING TO THE SIDE OF THE PROPOSED UTILITY MAIN
  3. FOR ELECTRICAL SERVICES, THE MARKER TAPE MUST BE PLACED 150mm ABOVE THE CONDUIT OR PER ELECTRICAL AUTHORITY'S REQUIREMENTS.
  4. ALL DIMENSIONS IN MILLIMETRES WHERE NOT SPECIFIED



No	Revision	Note: * indicates signatures on original issue of drawing or last revision of drawing	Drawn	Checked	Approved	Date
1	REVISED		LS	VD	-	28.08.20
0	FINAL ISSUE		DG	MM	-	16.11.15

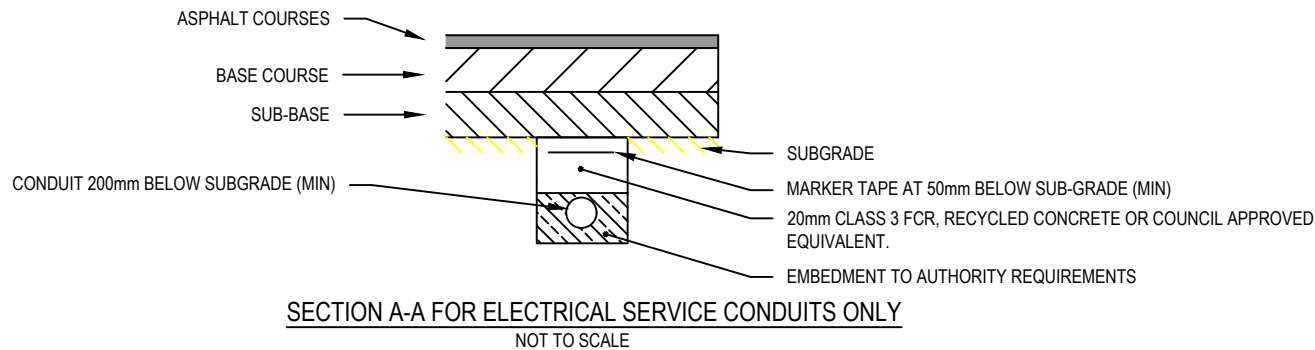

STANDARD DRAWINGS FOR  
SUBDIVISIONS IN GROWTH AREAS  
**SUBSURFACE DRAIN  
BACK OF KERB FOR  
NON-EXPANSIVE SUBGRADE**

Revision | 1  
Date | AUG 2020  
**EDCM 202b**