



Bushfire Development Report

to inform the
Greater Avalon Employment Precinct

Prepared for
Victorian Planning Authority

November 2025

WWW.TERRAMATRIX.COM.AU

Terramatrix project code: VPA-2025-05 CI1302_BPA-Greater Avalon Employment Precinct
Report prepared by Terramatrix for Victorian Planning Authority

Cover photo – Looking north from Dandos Road across the Western section of the precinct towards the You Yangs.

Terramatrix Pty. Ltd.

ACN: 129 163 373 ABN: 44 129 163 373

PO Box 1391, Collingwood VIC 3066

P: 03 9417 2626

www.terramatrix.com.au

Accountability

Role	Name	Position
Project manager	Jon Boura	Managing Director
Site inspection	Jon Boura	Managing Director
Analysis and report compilation	Jon Boura Mark Garvey	Managing Director Senior Analyst
Peer review	John Eastwood	Senior Analyst

Version control

Version	Date	Comments	Undertaken by
0.1	2025-08-11	Draft BDR.	JB
0.1	2025-08-12	Peer review.	JE
1.0	2025-08-13	Draft BDR to client.	JB
1.1	2025-09-23	Minor changes requested by VPA. Final BDR to client.	JB
1.2	2025-10-09	Correction to headings in Section 7.	JB
1.3	2025-11-10	Minor correction.	JB

Copyright

Unless otherwise agreed in writing, this report is the intellectual property of Terramatrix. The report is designed to be used exclusively by the person that commissioned it. Permission must be sought prior to the reproduction of any portion of this document and every effort made to ensure proper referencing of this document.

Disclaimer

This report may be of assistance to you and has been made with careful consideration and with the best information available to Terramatrix at the time of writing. Before relying on information in this report, users should carefully evaluate the accuracy, completeness and relevance of the information provided for their purposes. Terramatrix Pty Ltd, its directors and employees do not guarantee that it is without flaw or omission of any kind or is wholly appropriate for your particular purposes and therefore disclaim all liability for any error, loss or other consequence that may arise from you relying on any information in this report.

GIS disclaimer

Spatial data was supplied by the State Government of Victoria. Care was taken with the creation of maps used in this report, however the accuracy cannot be guaranteed. Users of the maps should make appropriate enquiries to ascertain the useability of this information.

TABLE OF CONTENTS

GLOSSARY.....	3
1 SUMMARY	5
2 INTRODUCTION	6
3 OVERVIEW OF THE PRECINCT	7
4 BUSHFIRE PLANNING AND BUILDING CONTROLS.....	9
4.1 PLANNING PROVISIONS	9
4.2 BUSHFIRE PRONE AREA (BPA)	11
4.3 OTHER CONTROLS	13
5 BUSHFIRE HAZARD ASSESSMENT.....	14
5.1 VEGETATION	14
5.2 FUTURE VEGETATED FORM.....	20
5.3 TOPOGRAPHY.....	21
5.4 FIRE WEATHER.....	24
5.5 LANDSCAPE ASSESSMENT.....	25
5.6 AGENCY STRATEGIES AND PLANS	30
6 PLANNING AND DESIGN RESPONSE	33
6.1 BUILDING SETBACKS.....	33
6.2 BUSHFIRE ATTACK LEVEL (BAL) CONSTRUCTION STANDARD	36
6.3 ACCESS AND EGRESS	38
6.4 VEGETATION MANAGEMENT WITHIN THE PRECINCT	38
6.5 BUSHFIRE SITE MANAGEMENT PLAN	39
6.6 EXCISION OF AREAS FROM THE BPA.....	39
6.7 FIRE SERVICE DELIVERY	39
6.8 INCORPORATING BUSHFIRE PROTECTION MEASURES IN THE DPO	39
7 CLAUSE 13.02-1S BUSHFIRE PLANNING	40
7.1 PROTECTION OF HUMAN LIFE STRATEGIES	40
7.2 BUSHFIRE HAZARD IDENTIFICATION AND ASSESSMENT STRATEGIES	42
7.3 SETTLEMENT PLANNING STRATEGIES	44
8 CONCLUSION.....	46
9 REFERENCES	49
10 APPENDIX: BAL CONSTRUCTION STANDARDS	52

Glossary

AS 3959:2018	AS 3959:2018 <i>Construction of buildings in Bushfire Prone Areas</i> . Australian standard invoked by the National Construction Code and Victorian building regulations for the assessment of BALs and the design and construction of defined building classes in a BPA.
BAL	<i>Bushfire Attack Level</i> - A means of measuring the severity of a building's potential exposure to ember attack, radiant heat and direct flame contact, using increments of radiant heat expressed in kilowatts per metre squared, and the basis for establishing the requirements for construction to improve protection of building elements from attack by bushfire e.g. a building constructed to a BAL-12.5 standard is designed to be exposed to radiant heat not exceeding 12.5 kW/m ² .
BMO	<i>Bushfire Management Overlay</i> - A planning scheme provision used to guide the development of land in areas of high bushfire hazard. The BMO applies to areas where there is potential for extreme bushfire behaviour, such as a crown fire and extreme ember attack and radiant heat
BPA	<i>Bushfire Prone Area</i> - An area that is subject to, or likely to be subject to, bushfire attack as determined by the Minister for Planning.
Bushfire	An unplanned fire burning in vegetation; sometimes referred to as wildfire. A generic term which includes grass fires, forest fires and scrub fires.
Bushfire attack	Attack by wind, burning embers, radiant heat or flame generated by a bushfire.
Bushfire hazard	A specific source of potential damage or harm, typically consisting of three key elements; vegetation, weather and topography.
Bushfire risk	The chance or probability of damage or harm if exposed to a bushfire hazard and the severity of the impact i.e. consideration of the likelihood and consequences of impacts from bushfire.
Classified vegetation	Vegetation deemed to be a bushfire hazard in accordance with the Bushfire Management Overlay (BMO) and/or AS 3959:2018 <i>Construction of buildings in bushfire prone areas</i> .
CFA	<i>Country Fire Authority</i>
Effective slope	The slope of the land (gradient, measured in degrees) under the classified vegetation which most influences the bushfire attack. The slope is determined on the basis of the fire moving towards the building and the rate of spread of the fire and not solely on the basis of the relative elevation of the vegetation.

Ember attack	Attack by smouldering or flaming windborne debris that is capable of entering or accumulating around a building, and that may ignite the building or other combustible materials and debris.
EVC	<i>Ecological Vegetation Class</i> - The standard unit for classifying vegetation types in Victoria. EVCs are described through a combination of floristics, lifeforms and ecological characteristics, and through an inferred fidelity to particular environmental attributes. Each EVC includes a collection of floristic communities (i.e. lower level in the classification) that occur across a biogeographic range and, although differing in species, have similar habitat and ecological processes operating.
FFDI	<i>Forest Fire Danger Index</i> – A numerical index representing the chance of a fire starting, its rate of spread, its intensity and the difficulty of its suppression, according to various combinations of air temperature, relative humidity, wind speed and both the long- and short-term drought effects.
FRV	<i>Fire Rescue Victoria</i>
PSP	<i>Precinct Structure Plan</i> – Strategic masterplans for local areas that usually cater for between 5,000 to 30,000 people, 2,000 to 10,000 jobs or a combination of both. They are the ‘blueprint’ for localised development and investment that will occur over many years, and will incorporate any relevant directions already outlined in a higher level Framework Plan.
RHF	<i>Radiant heat flux</i> - The heat transfer rate per unit area from thermal (electromagnetic) radiation, expressed as kilowatts per metre squared. Calculated or measured for a specific surface to determine the radiant heat received by that surface from flames associated with a bushfire.
VPA	<i>Victorian Planning Authority</i>

1 Summary

The Victorian Planning Authority are planning the Greater Avalon Employment Precinct, to guide the future urban development of land around Avalon Airport. The land will be rezoned from Farming Zone and Special Use Zone to Industrial 1 Zone and Rural Conservation Zone and a Development Plan Overlay (DPO) applied to facilitate development as a predominantly industrial area.

The precinct is partially within a designated Bushfire Prone Area (BPA) but not covered by the Bushfire Management Overlay (BMO). The re-zoning and DPO require a planning scheme amendment and constitute settlement planning and, as such, Clause 13.02-1S *Bushfire Planning* of the Greater Geelong Planning Scheme requires that bushfire risk be considered (Clause 13.02-1S, Greater Geelong Planning Scheme).

Key points:

- The precinct is partially within a designated BPA.
- The precinct is close to the established urban areas of Lara and Geelong, that include areas that would be rated as BAL-Low using the AS 3959:2018 site assessment methodology.
- Grassland, Shrubland and Forest, adjacent to and within the precinct, comprises a bushfire hazard that must be considered in the development and use of the precinct.
- Future conservation reserves and drainage reserves may comprise a bushfire hazard that must be considered in the development of adjacent land.
- The terrain within and around the precinct is benign from a bushfire perspective, being in the 'Flat land and all upslopes' or 'Downslopes >0-5°' slope classes.
- To reduce radiant heat flux to less than 12.5 kW/m² as required by Clause 13.02-1S *Bushfire Planning* for a planning scheme amendment that will result in the introduction or intensification of development in a BPA, buildings will need to be setback 19 m or 22 m from classified Grassland or Shrubland, 33 m or 41 m from Woodland and 48 m or 57 m from classified Forest, depending upon the effective slope.
- Large areas of the precinct will achieve the less than 12.5 kW/m² threshold upon the completion of development.
- The DPO can stipulate bushfire protection measures, including setback of buildings from classified vegetation, provision of perimeter roads, provision of multiple egress roads away from the enduring bushfire hazard outside the precinct, provision of fire brigade access and a reticulated hydrant system, inclusion of bushfire in emergency management plans for businesses operating in the precinct, maintenance of low threat vegetation on private property within the precinct, and requirement for a Bushfire Site Management Plan for stage subdivisions.

- Much of the precinct is likely to be rendered low threat by the planned urban development and may become eligible for excision from the BPA as development proceeds.

2 Introduction

This Bushfire Development Report has been prepared for the Victorian Planning Authority (VPA) to assess how development in the Greater Avalon Employment Precinct can respond to the bushfire risk and comply with the applicable planning and building controls that relate to bushfire, especially the objectives and strategies of the Planning Policy Framework (PPF) at Clause 13.02-1S *Bushfire Planning* in the Greater Geelong Planning Scheme.

The VPA are currently planning the Greater Avalon Employment Precinct to guide the future urban development of the land. The precinct comprises Western and Northern sections. Land in the Northern precinct is currently zoned Farming Zone (FZ), whilst in the Western precinct the land previously used for salt production is in the Special Use Zone – Schedule 1 (SUZ1) and the remainder is FZ.

The intent is to re-zone the Western precinct to Industrial 1 Zone (IN1Z) and Rural Conservation Zone (RCZ) and apply a Development Plan Overlay (DPO) to facilitate development as predominantly industrial areas. The Northern precinct will not be rezoned as part of the VPA's planning scheme amendment, but a planning policy will be included setting out the criteria for when of this can occur in the future.

The DPO will contain bushfire protection requirements commensurate to the level of bushfire risk to the precinct. A staging plan is yet to be developed but it is assumed the precinct will be developed in stages over several years.

The precinct is partially in a designated Bushfire Prone Area (BPA), with the FZ land within the precinct generally being in the BPA and the old salt production site and associated wetlands not. Adjacent agricultural land, to the west and north of the precinct is also in the BPA, but the irrigated farmland in the Melbourne Water Western Treatment Plant to the east is not a designated BPA. None of the precinct or surrounding land from more than 2.5 km is covered by the Bushfire Management Overlay (BMO), which denotes areas of higher bushfire hazard. The closest BMO coverage is a small area around Serendip Sanctuary and Serendip Wetlands Wildlife Reserve, beyond Lara to the north of the precinct.

Avalon Airport, which is leased Commonwealth land, lies between the Western and Northern sections of the precinct but will not be covered by the precinct structure plan. The airport is in the BPA, despite the central area appearing to be regularly mown.

This report has been prepared in accordance with guidance for the assessment of, and response to, bushfire risk, provided in:

- *Local planning for bushfire protection*, Planning Practice Note 64 (DELWP, 2015)
- *Design Guidelines, Settlement Planning at the Bushfire Interface* (DELWP, 2020a)
- *Planning Permit Applications – Bushfire Management Overlay*, Technical Guide (DELWP, 2017)
- *Bushfire State Planning Policy Amendment VC140*, Planning Advisory Note 68, (DELWP, 2018).
- *Applying the Bushfire Hazard Landscape Assessment in a Bushfire Management Overlay* (CFA, 2022a).

3 Overview of the precinct

The Greater Avalon Employment Precinct is located adjacent to the eastern edge of the Lara township (see Map 1), in the City of Greater Geelong local government area. The precinct comprises approximately 1,547 ha of land (Western section 927 ha and Northern section 620 ha), generally bounded by:

- To the north – Princes Freeway.
- To the west – Avalon Road.
- To the south – the Avalon Coastal Reserve (Western section of precinct) and Beach Road (Northern section of precinct).
- To the east – Avalon Airport (Western section of precinct) and Western Treatment Plant (Northern section of precinct).

Development plans will be prepared by landowners once the planning scheme amendment is gazetted. The precinct will be developed with industrial and commercial buildings. We understand the precinct will contain conservation and drainage reserves but the location, size and nature of the vegetation they will contain is not known at the time of this report. Thus, this Bushfire Development Report provides a high-level assessment of how industrial or commercial development in the precinct can respond to the bushfire hazard in accordance with the requirements of Clause 13.02-1S in the Greater Geelong planning scheme.



Map 1 – Location of the Greater Avalon Employment Precinct.

4 Bushfire planning and building controls

This section summarises the applicable planning and building controls that relate to bushfire.

4.1 Planning provisions

4.1.1 *Clause 12.03-1S River and riparian corridors, waterways, lakes, wetlands and billabongs*

As the Greater Avalon Employment Precinct will likely incorporate areas of wetland in drainage reserves, this Clause may have implications for the precinct. Strategies of the clause relevant to bushfire are:

- *‘Retaining, enhancing and re-establishing indigenous riparian vegetation along waterway systems, ensuring it responds to the bushfire risk of a location.*
- *Retaining and re-establishing vegetation, including grasslands and canopy trees, surrounding waterway systems to enhance and connect to the landscape setting, ensuring it responds to the bushfire risk of a location’* (Clause 12.03-1S, Greater Geelong Planning Scheme).

4.1.2 *Clause 13.01-1S Natural hazards and climate change*

The objective of this Clause is to minimise the impacts of natural hazards and adapt to the impacts of climate change through risk-based planning. Strategies to achieve the objective are:

- *‘Respond to the risks associated with climate change in planning and management decision making processes.*
- *Identify at risk areas using the best available data and climate change science.*
- *Integrate strategic land use planning with emergency management decision making.*
- *Direct population growth and development to low risk locations.*
- *Develop adaptation response strategies for existing settlements in risk areas to accommodate change over time.*
- *Ensure planning controls allow for risk mitigation and climate change adaptation strategies to be implemented.*
- *Site and design development to minimise risk to life, health, property, the natural environment and community infrastructure from natural hazards’* (Clause 13.01-1S, Greater Geelong Planning Scheme).

Especially in southern and eastern Australia, since the 1950’s there has been an increase in the length of the fire weather season and a greater number of higher risk days associated with climate change (CSIRO/BOM, 2024). The Australian and New Zealand Council for Fire and Emergency Services identify that a failure of building codes and land use planning to adequately adapt to climate change is a significant risk (AFAC, 2020).

Clause 13.01-1S supports the adoption of a precautionary and conservative approach to assessing and responding to bushfire risk. Fire weather is discussed further in Section 5.4.

4.1.3 Clause 13.02-1S Bushfire Planning

Clause 13.02-1S has the objective '*To strengthen the resilience of settlements and communities to bushfire through risk based planning that prioritises the protection of human life*' (Clause 13.02-1S, Greater Geelong Planning Scheme). The policy must be applied to all planning and decision making under the Planning and Environment Act 1987, relating to land which is:

- Within a designated BPA
- Subject to a BMO
- Proposed to be used or developed in a way that may create a bushfire hazard.

The policy requires priority to be given to the protection of human life by:

- '*Prioritising the protection of human life over all other policy considerations.*
- '*Directing population growth and development to low risk locations and ensuring the availability of, and safe access to, areas where human life can be better protected from the effects of bushfire.*
- '*Reducing the vulnerability of communities to bushfire through consideration of bushfire risk in decision-making at all stages of the planning process*' (Clause 13.02-1S, Greater Geelong Planning Scheme).

Key strategies are stipulated in Clause 13.02-1S, which require regional growth plans, precinct structure plans and planning scheme amendments to assess the bushfire hazard and respond with appropriate bushfire protection measures. This also applies to planning permit applications for:

- Subdivisions of more than 10 lots
- Accommodation
- Child care centre
- Education centre
- Emergency services facility
- Hospital
- Indoor recreation facility
- Major sports and recreation facility
- Place of assembly
- Any application for development that will result in people congregating in large numbers.

This study assesses the bushfire hazard in accordance with hazard identification and assessment strategies of Clause 13.02-1S and identifies the bushfire protection measures that will be required for future development in accordance with the settlement planning strategies. It is considered that development in the Greater Avalon Employment Precinct can appropriately

prioritise the protection of human life and meet the objective of Clause 13.02-1S. Key features to achieve this are appropriate subdivision design, including lot layout, perimeter roads and separation from hazardous vegetation during and after development. Minimum separation distances should ensure future development will not be exposed to radiant heat flux above 12.5 kW/m².

The maximum 12.5 kW/m² safety threshold is required in settlement planning as the upper limit for acceptable risk. Responsible authorities must *'Not approve any strategic planning document, local planning policy, or planning scheme amendment that will result in the introduction or intensification of development in an area that has, or will on completion have, more than a BAL-12.5 rating under AS 3959-2018'* (Clause 13.02-1S, Greater Geelong Planning Scheme).

A detailed response to the strategies in Clause 13.02-1S and recommendations for development are provided in Section 7.

4.1.4 Clause 71.02-3 Integrated Decision Making

Clause 71.02-3 states that planning and responsible authorities should endeavour to integrate policies and balance conflicting objectives in favour of net community benefit. However, in bushfire affected areas, it states that the protection of human life must be prioritised over all other policy considerations (Clause 71.02-3, Greater Geelong Planning Scheme).

4.2 Bushfire Prone Area (BPA)

BPAs are those areas subject to or likely to be subject to bushfire, as determined by the Minister for Planning. The FZ land within the precinct is currently designated as a BPA, however as development occurs, much of it will likely become eligible for excision from the BPA.

Note that land not within the BPA is defined as an area of low bushfire hazard, where the extent, configuration and/or management of vegetation results in low potential for bushfire spread (DELWP, 2019).

Map 5 shows the extent of BPA coverage in and around the precinct and the surrounding broader landscape. In a BPA, the Building Act 1993 and associated Building Regulations 2018, through application of the National Construction Code 2022 (NCC), require specific design and

construction standards for Class 1, 2 and 3¹ buildings, certain Class 9 and 4 buildings², and Class 10A buildings³ or decks adjacent to, or connected with, these classes of buildings.

We understand that the precinct will contain industrial and/or commercial buildings that will likely be of a class that does not need to be built to a BAL construction standard under the Victorian Building Regulations.

4.2.1 Land use planning in a BPA

In a BPA, larger developments and certain vulnerable uses, including applications for subdivision of more than 10 lots, are required by Clause 13.02-1S to:

- *‘Consider the risk of bushfire to people, property and community infrastructure.*
- *Require the implementation of appropriate bushfire protection measures to address the identified bushfire risk.*
- *Ensure new development can implement bushfire protection measures without unacceptable biodiversity impacts’* (Clause 13.02-1S, Greater Geelong Planning Scheme).

There are no obstacles to future development in the Greater Avalon Employment Precinct complying with the applicable strategies at Clause 13.02-1S and the building regulations invoked in a BPA. BAL-LOW land, where the BPA has been removed, will likely be created within the precinct as reliably low threat and non-vegetated areas are created as development progresses.

DTP review and excise areas from the BPA approximately every 6 months, particularly in growth areas where the hazard is removed as urban development occurs.

Land becomes eligible for excision if it satisfies statewide hazard mapping criteria, including that the land needs to be:

- At least 300 m from areas of classified vegetation (except grassland) larger than 4 ha in size; and
- At least 150 m from areas of classified vegetation (except grassland) 2 to 4 ha in size; and
- At least 60 m from areas of unmanaged grassland more than 2 ha in size (DELWP, 2019).

¹ Class 1, 2 and 3 buildings are defined in the NCC and are generally those used for residential accommodation, including houses and other dwellings, apartments, hotels and other buildings with a similar function or use.

² Applicable Class 9 buildings are Class 9a health-care buildings, Class 9b early childhood centres, primary and secondary schools, Class 9c residential care buildings, and any Class 4 parts of a building associated with these Class 9 buildings.

³ Class 10a buildings are defined in the NCC as non-habitable buildings including sheds, carports, and private garages.

For isolated areas of vegetation greater than 1 ha but less than 2 ha, the shape of the area and connectivity to any other hazardous vegetation is a further consideration (DELWP, 2019).

4.3 Other controls

4.3.1 Zoning

Land in the Northern precinct is currently zoned Farming Zone (FZ), whilst in the Western precinct the land previously used for salt production is in the Special Use Zone – Schedule 1 (SUZ1) and the remainder is FZ.

The intent is to re-zone the Western precinct to Industrial 1 Zone (IN1Z) and Rural Conservation Zone (RCZ). The Northern Precinct will not be rezoned as part of the VPA's planning scheme amendment, but a planning policy will be included setting out the criteria for when rezoning of this can occur in the future.

4.3.2 Overlays

Clause 42.01 Environmental Significance Overlay

Schedule 2 to the Environmental Significance Overlay (ESO2) applies to parts of the Western precinct and protects high value wetlands and may influence the creation of conservation reserves within the precinct.

Schedule 4 (ESO4) covers the Northern section and parts of the Western section of the precinct and focuses on protecting grasslands within the Werribee Plain hinterland. The ESO4 will be removed from the Western precinct as a Native Vegetation Precinct Plan will instead apply.

Clause 42.02 Vegetation Protection Overlay

Schedule 1 to the Vegetation Protection Overlay (VPO1) seeks to protect significant vegetation and habitat on significant roadsides and linear reserves. It applies to the unmade Gillets Road reserve that runs between the Princes Freeway and Dandos Road and may influence the creation of conservation reserves within the precinct.

Clause 43.04 Development Plan Overlay

VPA propose to apply a Development Plan Overlay (DPO) to guide development within the precinct. Potential bushfire protection measures that could be incorporated in the DPO are discussed at Section 6.8.

Clause 44.04 Land Subject to Inundation Overlay

Schedule 1 to the Land Subject to Inundation Overlay affects parts of both the Western and Northern sections of the precinct. It may affect the location of developable land and drainage reserves and other public open space.

Clause 45.01 Public Acquisition Overlay

Schedule 14 to the Public Acquisition Overlay covers a potential rail link through the Northern section of the precinct from Avalon Airport to the main Melbourne-Geelong rail line.

5 Bushfire hazard assessment

One of the bushfire hazard identification and assessment strategies in Clause 13.02-1S is to use the best available science to identify the hazard posed by vegetation, topographic and climatic conditions. The basis for the hazard assessment should be:

- *‘Landscape conditions - meaning the conditions in the landscape within 20 kilometres and potentially up to 75 kilometres from a site;*
- *Local conditions - meaning conditions within approximately 1 kilometre from a site;*
- *Neighbourhood conditions - meaning conditions within 400 metres of a site; and,*
- *The site for the development’* (Clause 13.02-1S, Greater Geelong Planning Scheme).

This section includes a bushfire assessment at:

- The wider landscape scale, for up to 10 km around the site (see Map 4).
- The local and neighbourhood scales extending up to 400 m and 1 km respectively from the site (see Map 5).
- The site scale up to 150 m around the precinct boundary (see Map 2 and Map 3).

The BPA invokes AS 3959:2018 *Construction of buildings in bushfire prone areas*, which requires a site assessment of the vegetation and topography up to 100 m around a building (Standards Australia, 2020). For vulnerable uses and larger developments in a BPA a 150 m assessment zone may be required (DELWP, 2018) as has been applied in this bushfire assessment.

5.1 Vegetation

Classified vegetation is vegetation that is deemed hazardous from a bushfire perspective and is classified in accordance with the AS 3959:2018 methodology.

The classification system is not directly analogous to Ecological Vegetation Classes (EVCs) but uses a generalised description of vegetation based on the AUSLIG (Australian Natural Resources Atlas: No. 7 - Native Vegetation) classification system. The classification should be based on the likely fire behaviour that it will generate and, for settlement planning purposes, the long-term structure of the vegetation in its mature state.

5.1.1 Grassland

Grassland is the predominant vegetation type within the Greater Avalon Employment Precinct (see Map 4) and in the 150 m site assessment zone adjacent to the northern, western and parts of the southern boundaries (see Figure 3 and Figure 4).

Areas of grassy vegetation greater than 100 mm high with an overstorey foliage cover of less than 10% are classifiable in the Grassland group of AS 3959:2018, which is defined as '*All forms (of vegetation) including areas with shrubs and trees, if overstorey foliage cover is less than 10%*' (Standards Australia, 2020).

Grassland vegetation is considered hazardous, and therefore classifiable, when it is unmanaged, i.e. more than 100 mm tall. Settlement planning should apply a conservative and precautionary approach, and assume Grassland areas will be unmanaged and classifiable, unless there is reasonable assurance they will be managed in a low threat state, no more than 100 mm high, in perpetuity.



Figure 1 – Cropping, classified as Grassland, south of Beach Road adjacent to the Northern section of the precinct.

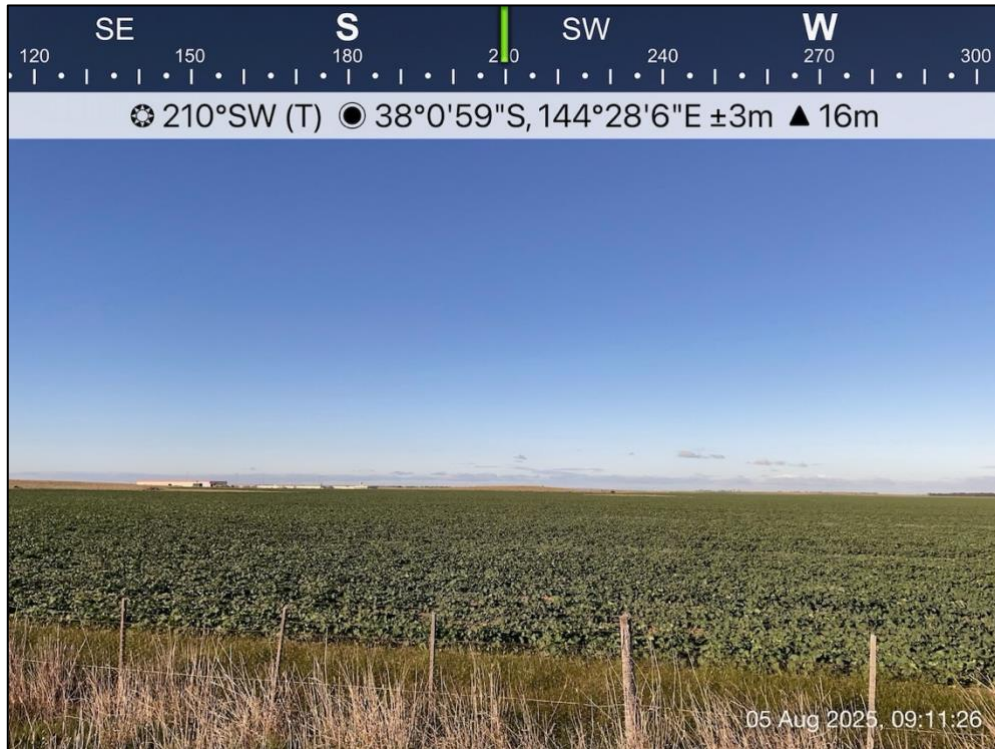


Figure 2 – Cropping, classified as Grassland, on Avalon Airport land south of Beach Road adjacent to the Northern section of the precinct.

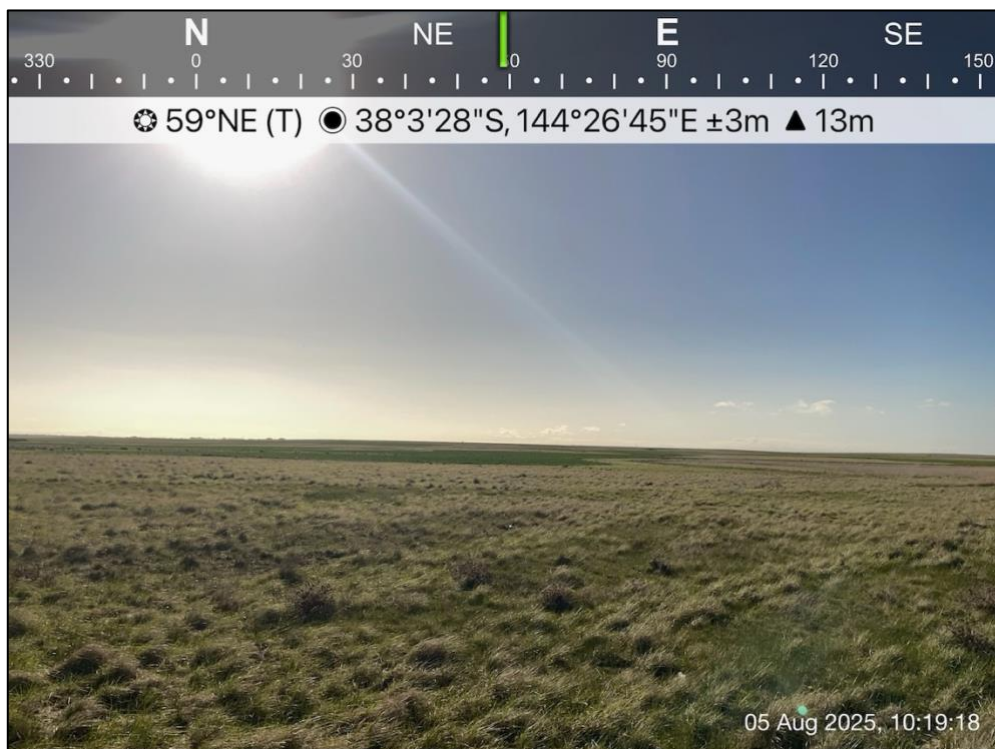


Figure 3 – Looking north-east from Dandos Road at classified Grassland on Avalon Airport to the east of the Western section of the precinct.

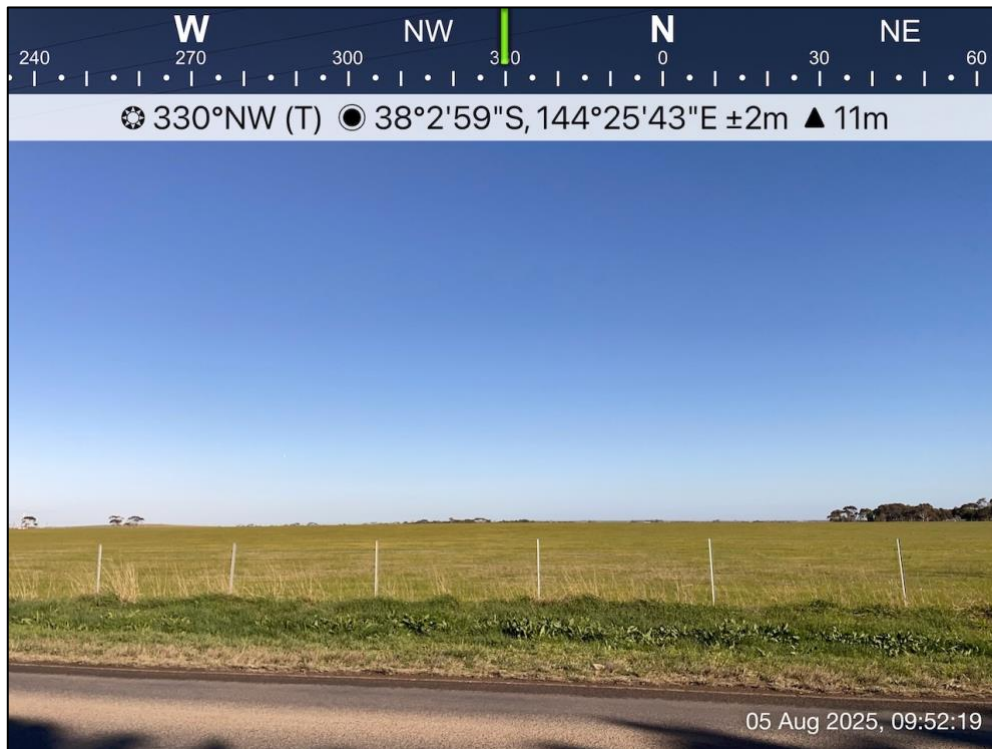


Figure 4 – Looking north-west from Avalon Road at classified Grassland to the west of the Western section of the precinct.

5.1.2 Shrubland

Some vegetation in the area previously used for salt production (see Figure 5) accords best with the BMO/AS 3959:2018 Shrubland group, which comprises areas with Shrubland group of AS 3959:2018. Shrubland comprises areas with shrubs that are on average less than 2 m tall, with more than 30% foliage cover. Understorey may contain grasses (Standards Australia, 2020).

On flat or gently sloping ground, such as in and around the precinct, the setbacks required for Shrubland are the same as those for Grassland.

5.1.3 Forest

Treed vegetation planted in Avalon Airport to counter salinity likely best accords with the Forest group of AS 3959:2018⁴. Forest vegetation comprises areas with trees to 30 m high or taller at maturity, typically dominated by eucalypts, with 30% to more than 70% foliage cover (may include understorey ranging from rainforest species and tree ferns to sclerophyllous low trees or shrubs). Includes pine and eucalypt plantations (Standards Australia, 2020).

⁴ This vegetation was not accessed and has been provisionally classified based on aerial imagery.

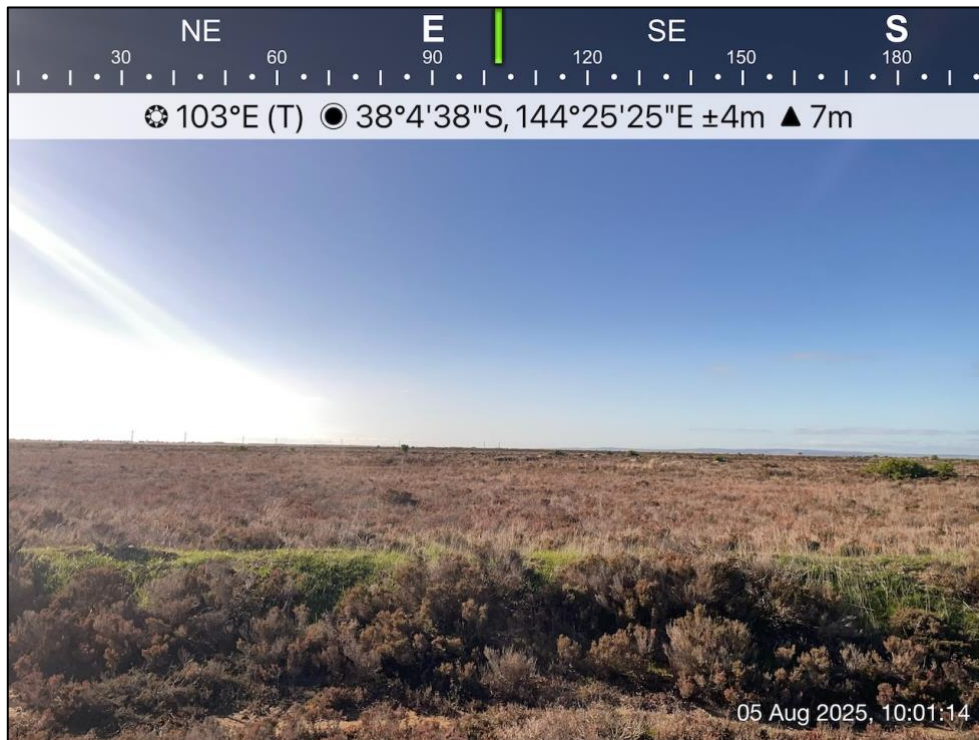


Figure 5 – Shrubland in the disused salt production area.

5.1.4 Other classified vegetation

The ecological assessment identified small patches of EVC 55 Plains Woodland at several locations in the precinct, generally on road reserves or along fence lines (EHP, 2025) within much larger areas of classified Grassland. With their current size and distribution these patches are not the predominant bushfire hazard but may need to be considered if they were to be expanded.

5.1.5 Excluded vegetation and non-vegetated areas

Areas of low threat vegetation and non-vegetated areas can be excluded from classification in accordance with Section 2.2.3.2 of AS 3959:2018, if they meet one or more of the following criteria:

- (a) *‘Vegetation of any type that is more than 100 m from the site.*
- (b) *Single areas of vegetation less than 1 ha in area and not within 100 m of other areas of vegetation being classified vegetation.*
- (c) *Multiple areas of vegetation less than 0.25 ha in area and not within 20 m of the site, or each other, or of other areas of vegetation being classified vegetation.*
- (d) *Strips of vegetation less than 20 m in width (measured perpendicular to the elevation exposed to the strip of vegetation) regardless of length and not within 20 m of the site or each other, or other areas of vegetation being classified vegetation.*
- (e) *Non-vegetated areas, that is, areas permanently cleared of vegetation, including waterways, exposed beaches, roads, footpaths, buildings and rocky outcrops.*

(f) Vegetation regarded as low threat due to factors such as flammability, moisture content or fuel load. This includes grassland managed in a minimal fuel condition⁵, mangroves and other saline wetlands, maintained lawns, golf courses (such as playing areas and fairways), maintained public reserves and parklands, sporting fields, vineyards, orchards, banana plantations, market gardens (and other non-curing crops), cultivated gardens, commercial nurseries, nature strips and windbreaks' (Standards Australia, 2020).' (Standards Australia, 2020).

Some residential properties west of Avalon Road and north of the Princes Highway, commercial/industrial sites south of Beach Road, and managed areas of the Avalon Airport comprise non-vegetated or low threat areas.

The disused salt pans south of the Western section of the precinct and the reliably irrigated crops in the Western Treatment Plant to the east of the Northern section can likely be excluded from classification as low threat vegetation under point (f) above, and it should be noted that these areas are not in a designated BPA. We consider it prudent, however, to provide building setbacks as discussed at Section 6.1 below.

It is reasonable to assume that all the proposed industrial/commercial areas will be either non-vegetated or comprise low threat vegetation such as maintained lawns, roadsides or cultivated gardens. It is also reasonable to assume that any local parks will be managed in a low threat state.

⁵ Minimal fuel condition means there is insufficient fuel available to significantly increase the severity of the bushfire attack, recognisable as short-cropped grass for example, to a nominal height of 100 mm (Standards Australia, 2020).

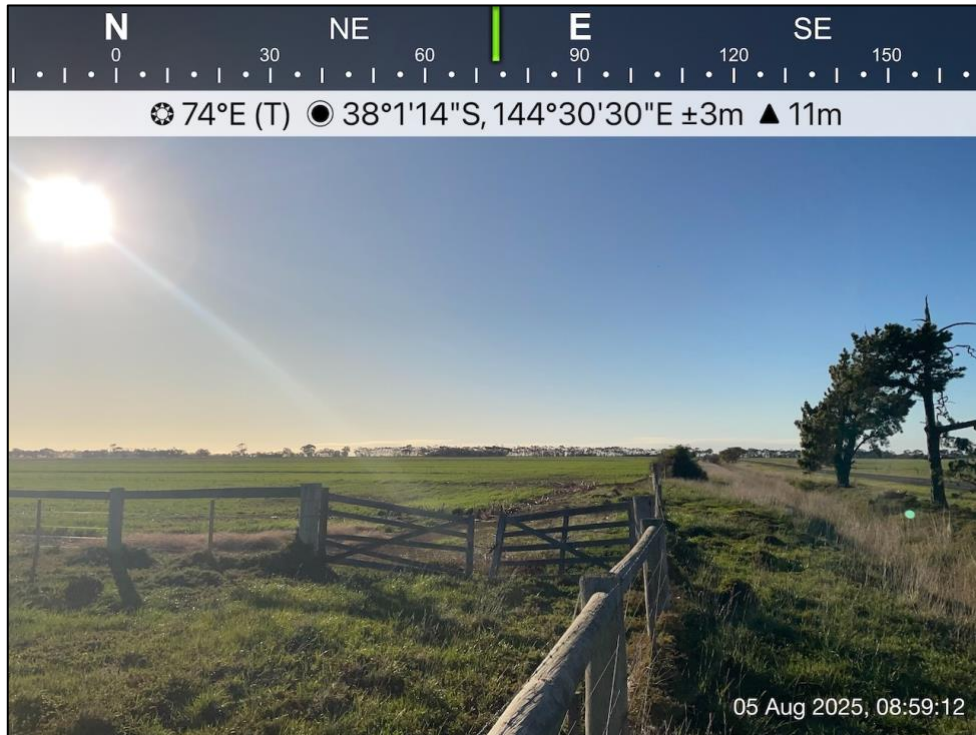


Figure 6 – Low threat irrigated cropping in the Western Treatment Plant.

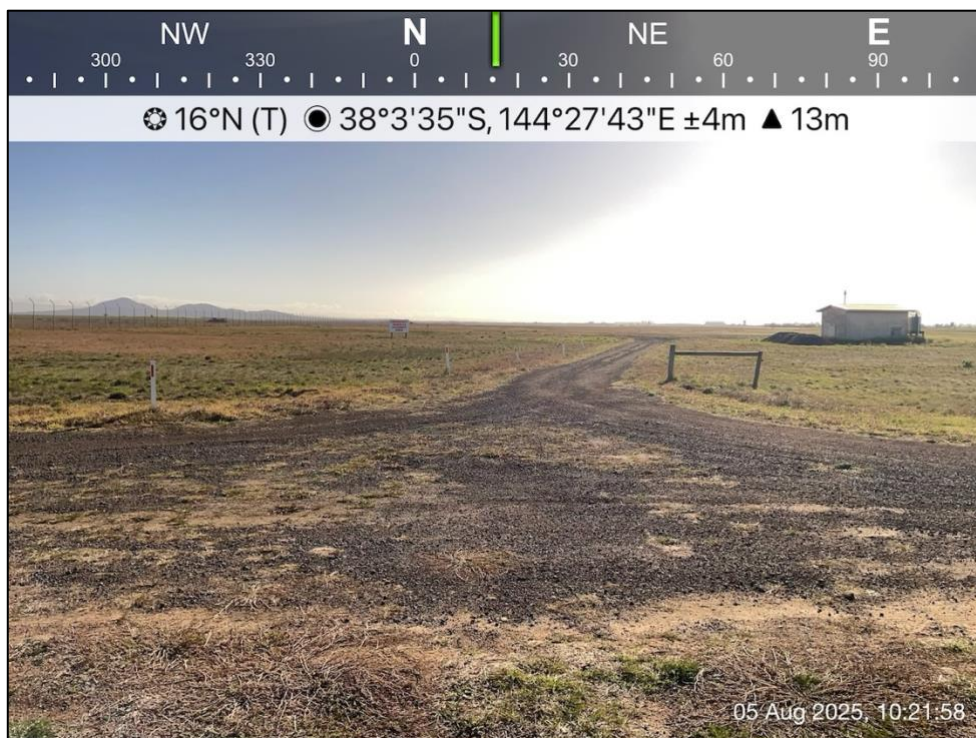


Figure 7 – Mown grass within the central fenced area at Avalon Airport.

5.2 Future vegetated form

It is assumed that classified Grassland on private property outside of the precinct will remain in the long term. It is assumed the road reserves within, and around the perimeter of, the precinct will be maintained in a low threat condition (grass generally < 100 mm in height).

In the longer term, it is feasible that further development within the Avalon Airport site will render additional land low threat, but that the tree planting along the boundary with the Western section of the precinct will remain and could be expanded.

Urban development in the Greater Avalon Employment Precinct will result in the removal of much of the classified Grassland from within the precinct boundary. We understand, however, that conservation and drainage reserves will be created that may comprise classified vegetation as described below. As development plans have not yet been prepared and in the absence of knowledge of what vegetation each reserve may contain, we provide general advice on the setbacks that might be required at Section 6.1 below.

5.3 Topography

AS 3959:2018 requires that the 'effective slope' be identified to determine the BAL and applicable development setback distances from classified vegetation. This is the slope of the land under classified vegetation that will most significantly influence the bushfire attack on a building. Two broad types apply:

- Flat and/or Upslope - land that is flat or on which a bushfire will be burning downhill in relation to the development. Fires burning downhill (i.e. on an upslope) will generally be moving more slowly with a reduced intensity.
- Downslope - land on which a bushfire will be burning uphill in relation to the development. As the rate of spread of a bushfire burning on a downslope (i.e. burning uphill towards a development) is significantly influenced by increases in slope, downslopes are grouped into five classes in 5° increments from 0° up to 20°⁶.

The Greater Avalon Employment Precinct and immediately surrounding landscape is coastal plain that is essentially flat (see Map 2 and Map 3), without significant changes in elevation that would appreciably influence bushfire behaviour.


For the purposes of determining BALs and defensible space/vegetation setback distances for future development, the applicable slope class for vegetation outside the precinct boundary is 'All upslopes and flat land'.

If classified vegetation is to be retained or created in drainage reserves within the precinct, it is feasible that slopes in the 'Downslope >0-5°' slope class may apply.

⁶ For downslope gradients over 20° and up to 30°, the detailed 'Method 2' procedure of AS 3959:2018 is used to determine the BAL.



Map 2 – Bushfire hazard site assessment – Western section. Vegetation classification as per AS 3959:2018 – existing classified vegetation within 150 m site assessment zone.


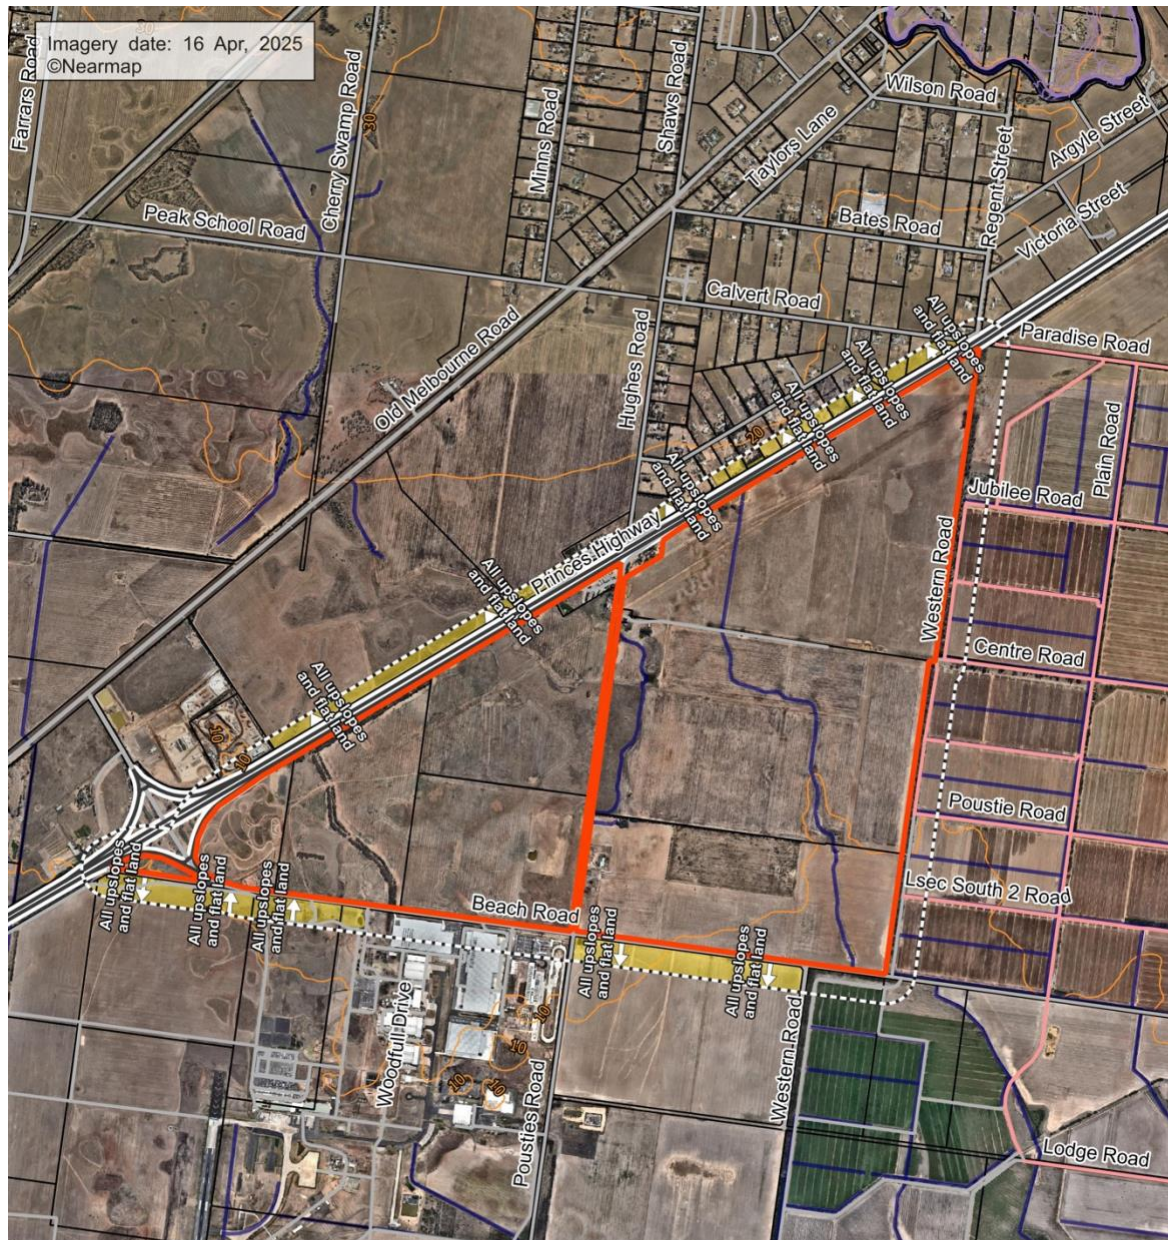


Greater Avalon Employment Precinct (Northern section) Bushfire Hazard Site Assessment

- | | |
|---|---|
| Precinct | Internal roads |
| Northern section | Western Treatment Plant |
| 150 m site assessment zone | Contours - 10 m |
| Cadastre | Watercourse |
| Freeway | Grassland |
| Arterial | |
| Minor road | |



12/8/2025



MG

Map 3 – Bushfire hazard site assessment – Northern section. Vegetation classification as per AS 3959:2018 – existing classified vegetation within 150 m site assessment zone.

5.4 Fire weather

The Forest Fire Danger Index (FFDI) and the Grassland Fire Danger Index (GFDI) represent the level of bushfire threat based on weather (and fuel) conditions. An FFDI 100/GFDI 130 is applied in non-alpine areas of Victoria by the building system, to establish a BAL based on building setback distances from classified vegetation in accordance with AS 3959:2018.

The indices were also used for predicting fire behaviour including the difficulty of suppression, forecasting Fire Danger Ratings (FDRs) and determining an appropriate level of preparedness for emergency services. However, since September 2022 the FFDI/GFDI have been replaced by the Fire Behaviour Index (FBI) as a new Australian Fire Danger Rating System (AFDRS) for determining FDRs in all jurisdictions. Table 1 displays the new FDRs, their FBI range, the anticipated fire behaviour and recommended actions for each FDR.

Note that the AFDRS and FBIs do not correlate directly with the FFDI/GFFDI indices applied in the planning and building system. However, the benchmark FFDI 100 used to represent a 'one size fits all' model of extreme fire weather conditions (and the threshold for the previous 'Code Red' FDR), can be considered analogous to the FBI 100 'Catastrophic' FDR. Note that these extreme conditions have been exceeded during significant fire events, including at some locations in Victoria on 'Black Saturday' 2009. Therefore, it is important to note that this FDR threshold is not necessarily the *worst-case* conditions for any particular location.

Additionally, as identified in Section 4.1.2, in southern and eastern Australia since the 1950's there has been an increase in the length of the fire weather season and an increase in extreme fire weather (CSIRO/BOM, 2024). The trend of a longer fire season and increased number of dangerous fire weather days is projected to continue. Climate change is contributing to these changes in fire weather including by affecting temperature, relative humidity and associated changes to the fuel moisture content (CSIRO/BOM, 2024).

The Barwon South West Bushfire Management Strategy also states that in Victoria, climate change is forecast to extend the length of the fire danger period, make bushfires larger, more severe and frequent, and increase the frequency of days of elevated fire danger (DELWP, 2020b).

Climate change trends associated with the risk of bushfire, support the adoption of a precautionary and conservative approach in identifying and responding to the risk. However, as CFA and DTP have no published policy on FFDI recurrence intervals there is no compelling reason to apply a different FFDI/GFDI from the FFDI 100/GFDI 130 threshold used throughout non-Alpine areas of Victoria in the planning and building system⁷.

⁷ In Alpine areas of Victoria an FFDI 50 applies for determining BALs using Method 1 of AS 3959:2018.

Table 1 - Fire Danger Ratings (AFDRS, 2022).

Forest Behaviour Index	Fire Danger Rating (FDR)	Fire Behaviour	Action
>=100	Catastrophic	If a fire starts and takes hold, lives are likely to be lost.	○ These are the most dangerous conditions for a fire. ○ Your life may depend on the decisions on you make, even before there is a fire. ○ For your survival, do not be in bushfire risk areas. ○ Stay safe by going to a safer location early in the morning or the night before. ○ If a fire starts and takes hold, lives and properties are likely to be lost. ○ Homes cannot withstand fires in these conditions. You may not be able to leave and help may not be available.
50-99	Extreme	Fires will spread quickly and be extremely dangerous.	○ These are dangerous fire conditions. ○ Check your bushfire plan and that your property is fire ready. ○ If a fire starts, take immediate action. If you and your property are not prepared to the highest level, go to a safer location well before the fire impacts. ○ Reconsider travel through bushfire risk areas. ○ Expect hot, dry and windy conditions. ○ Leaving bushfire risk areas early in the day is your safest option.
24-49	High	Fires can be dangerous.	○ There is a heightened risk. Be alert for fires in your area. ○ Decide what you will do if a fire starts. ○ If a fire starts, your life and property may be at risk. The safest option is to avoid bushfire risk areas.
12-23	Moderate	Most fires can be controlled.	○ Stay up to date and be ready to act if there is a fire.

5.5 Landscape assessment

5.5.1 Location description and context

The Greater Avalon Employment Precinct is located south of the Princes Highway, between Lara and Little River. To the south is Port Phillip Bay (see Map 1 and Map 4). Lara, to the immediate north-west of the Western section of the precinct, and Corio further to the south-west along Princes Highway, are low threat urban-residential landscapes. To the east are the irrigated crops of the Western Treatment Plant.

Land to the north of the precinct is primarily pastoral and a relatively low bushfire threat. The closest area of forest is Serendip Sanctuary and Serendip Wetlands Wildlife Reserve more than 2.5 km to the north-west, beyond Lara to the north of the precinct. The You Yangs Regional Park is just over 5 km to the north-west of the Northern section of the precinct.

5.5.2 Broader landscape scale hazard

To assist in assessing landscape risk, four 'broader landscape types', representing different landscape risk levels, are described in the technical guide *Planning Applications Bushfire Management Overlay*⁸. These descriptors are intended to streamline decision-making and support more consistent decisions based on the landscape risk (DELWP, 2017).

The four types range from low risk landscapes, where there is little hazardous vegetation beyond 150 m of a site and extreme bushfire behaviour is not credible, to extreme risk landscapes with limited or no evacuation options and where fire behaviour could exceed BMO/AS 3959:2018 presumptions (see Table 2).

The landscape setting of the Greater Avalon Employment Precinct accords best with the lower risk Landscape Type 2.

There is a history of bushfires in the You Yangs, that have spread to the south-east across farmland. In 1969 such a fire destroyed 43 homes in Lara and killed 18 people, including 8 caught in cars on the Princes Highway near Little River (Greater Geelong MEMPC, 2023), whilst in 1985, 90% of the You Yangs were burnt within several hours, 2 people were killed and more than 50 buildings destroyed (DELWP, 2020b). This scenario remains the most credible for a large, fully developed fire impacting the precinct, but the immediate approach would be through Grassland, and the fire would be unlikely to spread significantly into the new urban area assuming an appropriate edge treatment is provided.

The development of the precinct will provide a large, reliably low threat area that could provide a place of safety during bushfire. Lara, close to the Western section of the precinct also comprises a large area that is not in a designated BPA, with easy access to it from the precinct via the Princes Freeway.

⁸ Whilst no part of the precinct is covered by the BMO, the broader landscape types provide a commonly used description of landscape-scale risk.


Table 2 - Landscape risk typologies (from DELWP, 2017).

Broader Landscape Type 1	Broader Landscape Type 2	Broader Landscape Type 3	Broader Landscape Type 4
• <i>There is little vegetation beyond 150 metres of the site (except grasslands and low-threat vegetation).</i> • <i>Extreme bushfire behaviour is not possible.</i> • <i>The type and extent of vegetation is unlikely to result in neighbourhood-scale destruction of property.</i> • <i>Immediate access is available to a place that provides shelter from bushfire.</i>	• <i>The type and extent of vegetation located more than 150 metres from the site may result in neighbourhood-scale destruction as it interacts with the bushfire hazard on and close to a site.</i> • <i>Bushfire can only approach from one aspect and the site is located in a suburban, township or urban area managed in a minimum fuel condition.</i> • <i>Access is readily available to a place that provides shelter from bushfire. This will often be the surrounding developed area.</i>	• <i>The type and extent of vegetation located more than 150 metres from the site may result in neighbourhood-scale destruction as it interacts with the bushfire hazard on and close to a site.</i> • <i>Bushfire can approach from more than one aspect.</i> • <i>The site is located in an area that is not managed in a minimum fuel condition.</i> • <i>Access to an appropriate place that provides shelter from bushfire is not certain.</i>	• <i>The broader landscape presents an extreme risk.</i> • <i>Evacuation options are limited or not available.</i> • <i>Fires have hours or days to grow and develop before impacting.</i>
			

5.5.3 Local and neighbourhood scale hazard

A fire could start in paddocks to the west of the Western section of the precinct or south of the Northern section but there is insufficient space for a fire to develop fully.

Access for people in the Greater Avalon Employment Precinct would be readily available to reliably low threat or non-vegetated areas, either within the precinct after development, within the low threat central area of Avalon Airport or in the existing urban area of Lara.

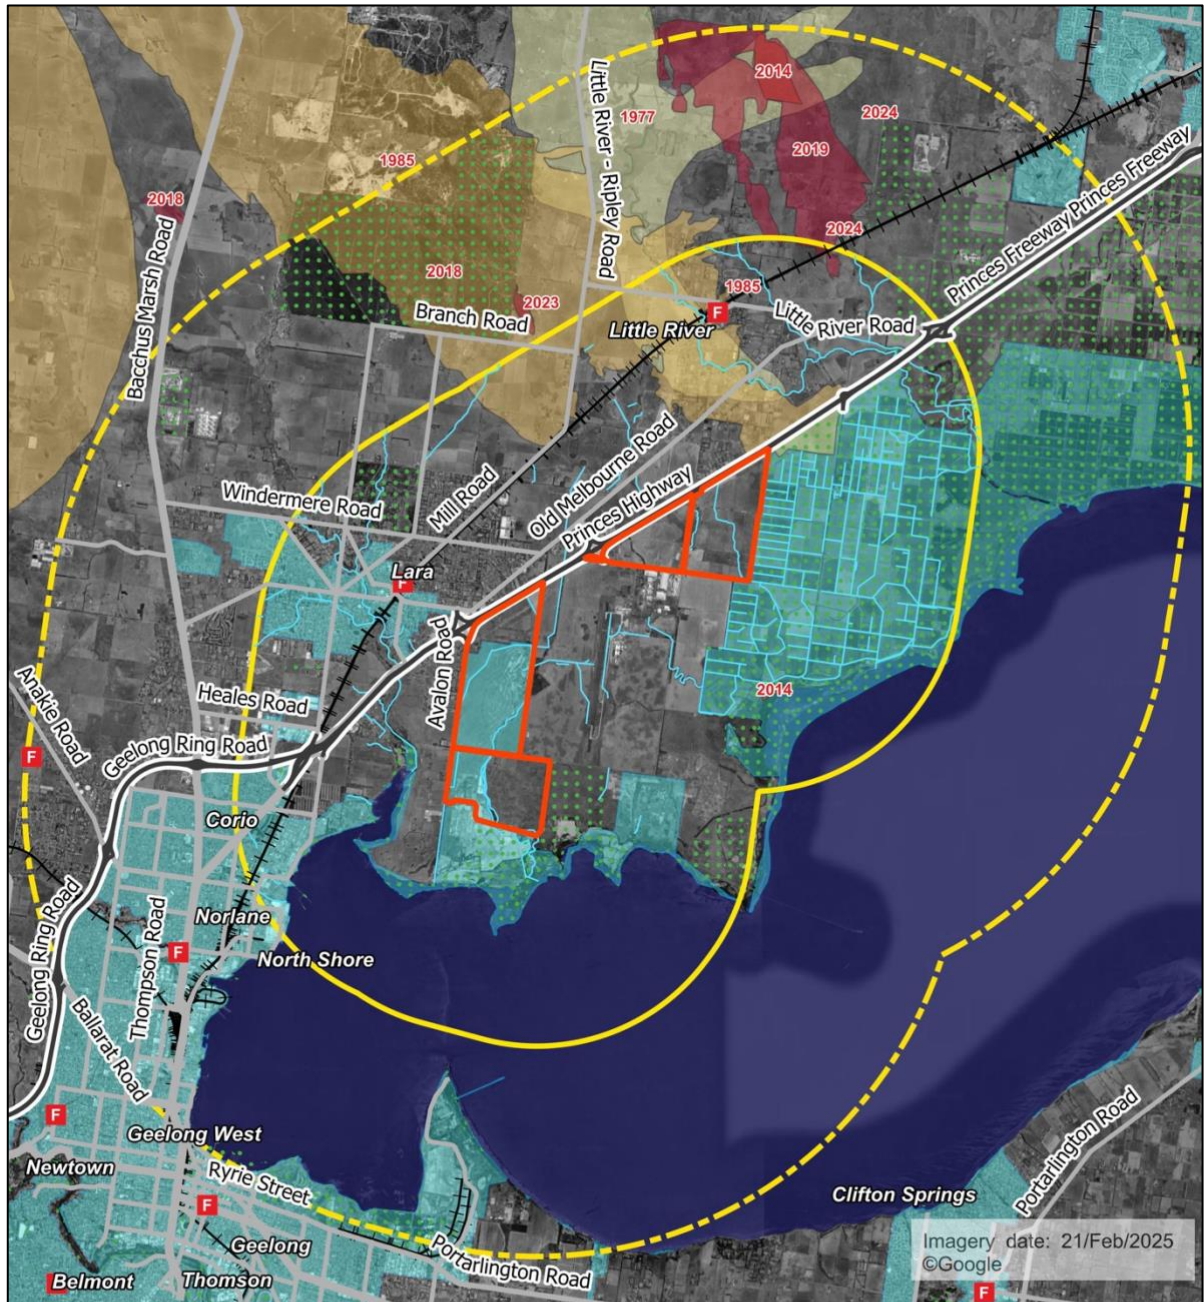

Greater Avalon Employment Precinct Bushfire Hazard Landscape Assessment


Precinct	Freeway	Bushfire (year)
5 km site buffer	Highway	1974 - 1984
10 km site buffer	Arterial	1984 - 1994
Fire station	Watercourse	1994 - 2004
Non-BPA land		2004 - 2014
Public land		2014 - 2024



12/8/2025



Map 4 - Bushfire hazard landscape assessment.

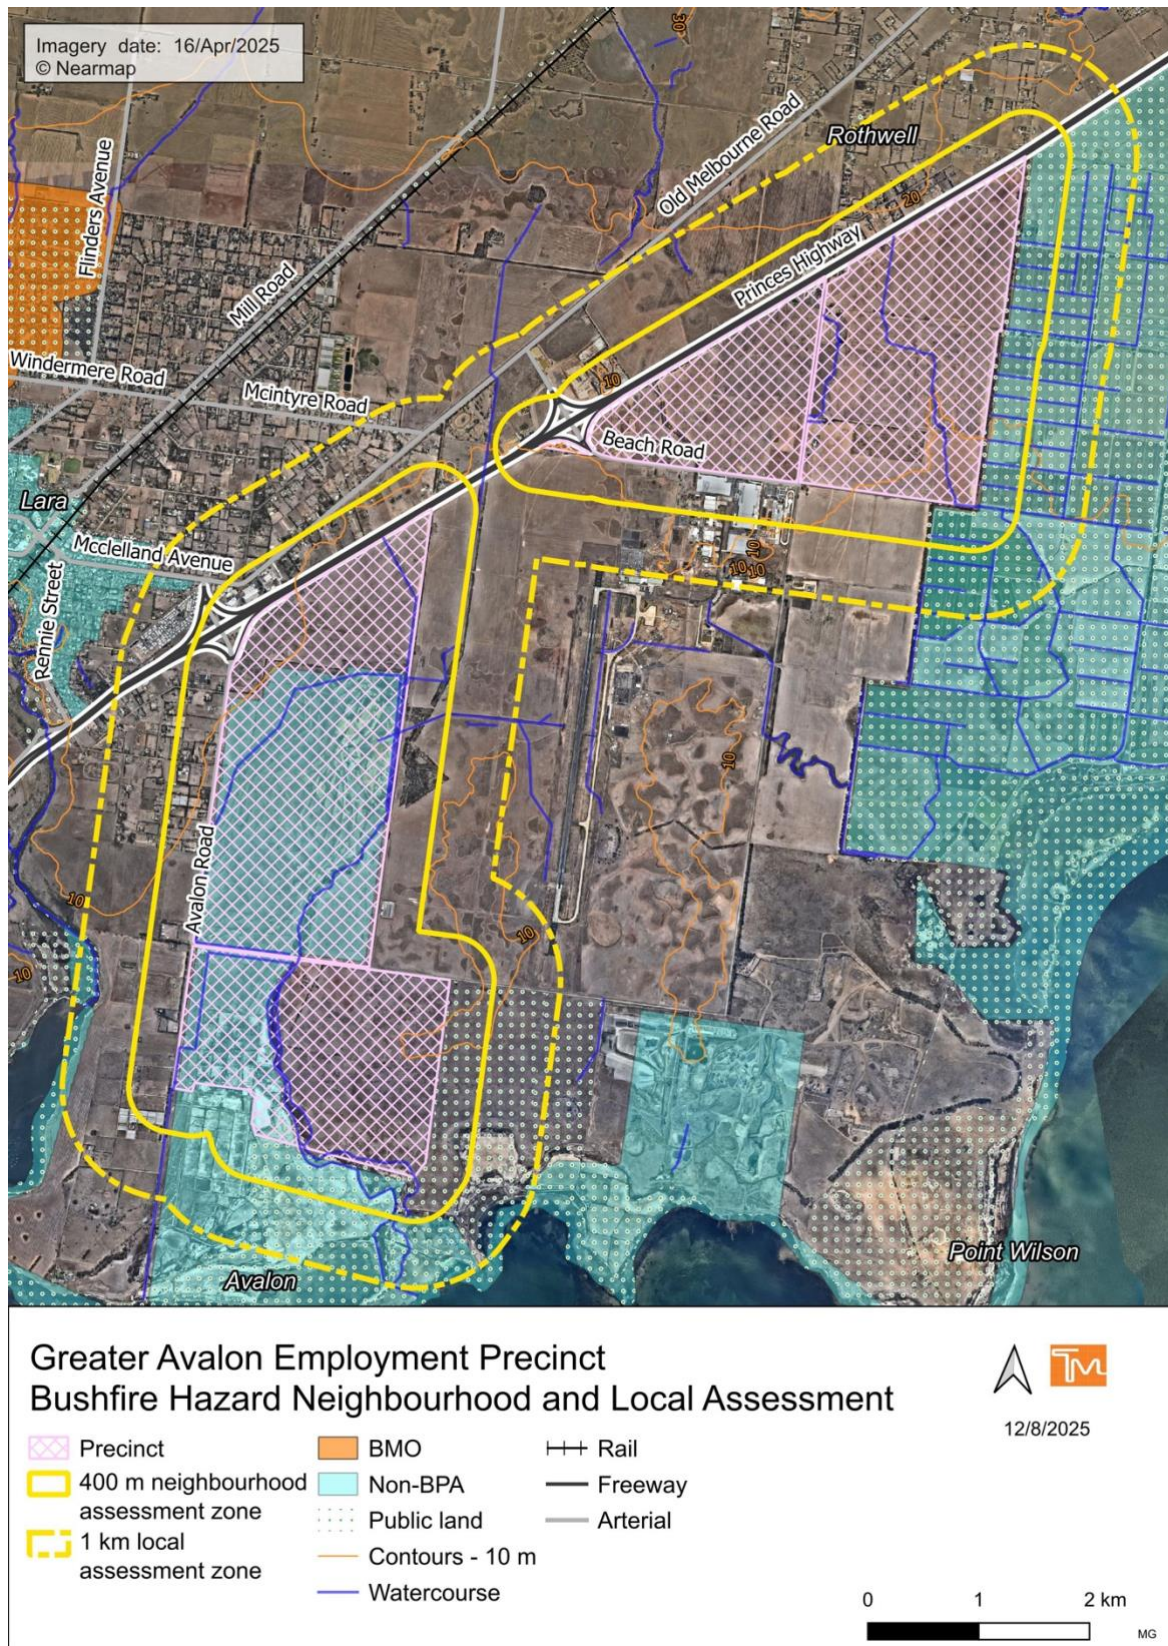

Map 5 - Bushfire hazard neighbourhood and local assessment.

5.6 Agency strategies and plans

5.6.1 Regional Bushfire Planning Assessment (RBPA) Grampians Region

As part of the response to the 2009 Victorian Bushfires Royal Commission, Regional Bushfire Planning Assessments (RBPAs) were undertaken across six regions that covered the whole of Victoria. The RBPAs provide information about 'identified areas' where a range of land use planning matters intersect with a bushfire hazard to influence the level of risk to life and property from bushfire. The RBPAs state that *'This information should be addressed as part of strategic land use and settlement planning at the regional, municipal and local levels'* (DPCD, 2012).

The *Regional Bushfire Planning Assessment – Barwon South West Region* covers the City of Greater Geelong. It identifies Lara as having an interface with grassland and the Serendip Sanctuary but does not identify any bushfire issues for the Greater Avalon Employment Precinct or immediately surrounding area (DPCD, 2012).

5.6.2 Barwon South West Bushfire Management Strategy 2020

Strategic bushfire management planning in Victoria is jointly delivered by FFMVic, CFA, FRV, EMV and local government. A key output is a Bushfire Management Strategy for each of the six planning regions that cover the state. Each strategy informs more detailed operational-level planning, including municipal fire prevention planning, the Joint Fuel Management Program, and readiness and response planning.

The Barwon South West Bushfire Management Strategy makes no specific mention of bushfire risk for the area around Lara and Avalon (other than the historical bushfires mentioned previously), whilst highlighting the hazard in the large areas of forest in the region, such as the Otway Ranges and southern Grampians Ranges (DELWP, 2020b).

Bushfire behaviour and house loss modelling show the area north-east of Geelong is rated as having the least risk (i.e. less than the lowest risk rating of 'Low-intermediate risk') for potential house loss in the Grampians region (DELWP, 2020b).

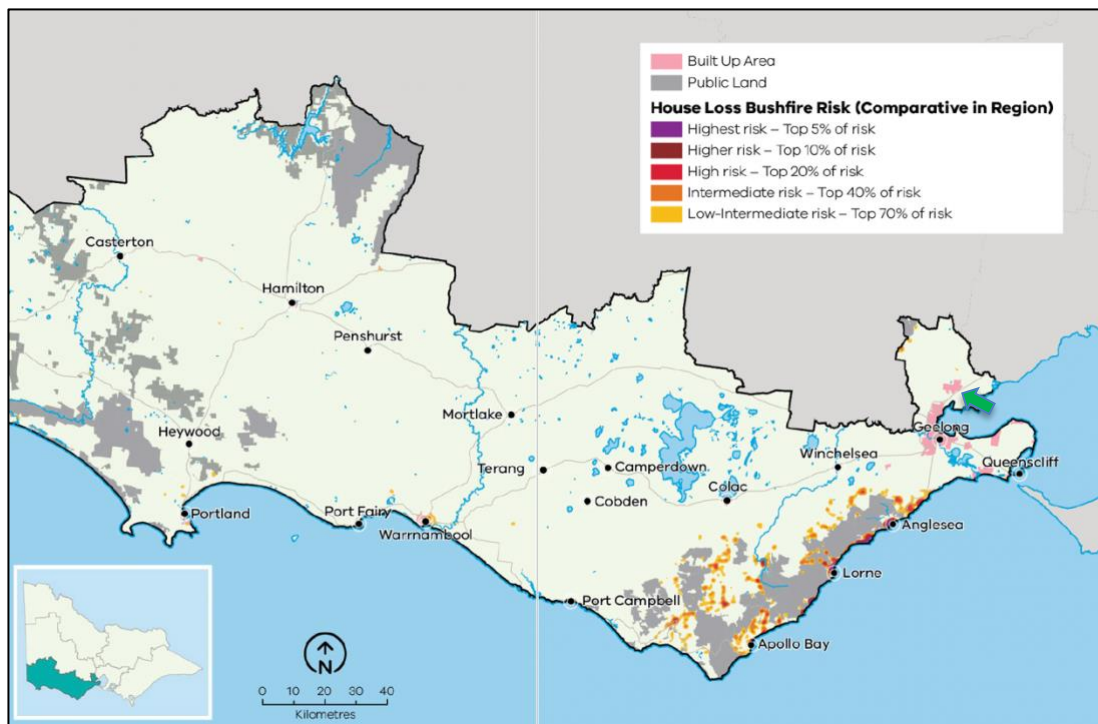


Figure 8 - Modelled risk of house loss (DELWP, 2020b). Approximate location of site indicated by tip of green arrow.

5.6.3 Greater Geelong Municipal Fire Management Sub-Plan

A Municipal Fire Management Plan (MFMP) has been prepared for the City of Greater Geelong and Borough of Queenscliff as a sub-plan to their Municipal Emergency Management Plans (Greater Geelong MEMPC, 2023).

The MFMP identifies a planned increase in infrastructure at Avalon Airport and in industry around Lara. The MFMP identifies the risk of fast-moving grassfires impacting built up areas and documents a range of mitigation programs (Greater Geelong MEMPC Sub-committee and Borough of Queenscliff MEMPC Sub-committee, 2023).

Mill Road, Old Melbourne Road and the Princess Freeway, all of which run approximately south-west to north-east, north of the Greater Avalon Employment Precinct, are identified as strategic fire breaks (Greater Geelong MEMPC Sub-committee and Borough of Queenscliff MEMPC Sub-committee, 2023).

5.6.4 Joint Fuel Management Program

There are no Fire Management Zones or mechanical fuel management scheduled in the vicinity of the Greater Avalon Employment Precinct (FFMVic, 2025). Further afield, public land at Serendip Sanctuary and the You Yangs Regional Park is Landscape Management Zone (see Figure

9), where planned burning will focus on maintaining and improving ecosystem resilience, and fuel management will also be undertaken for risk reduction (FFMVic, 2025).



Figure 9 - Fire Management Zones in the vicinity of the Greater Avalon Employment Precinct (FFMVic, 2025).

6 Planning and design response

This section identifies how future development can respond to the bushfire risk, including the requirements of Clause 13.02-1S, published CFA and DTP guidance and the building regulations applicable to construction in a BPA.

6.1 Building setbacks

6.1.1 Setback distances

The 'Settlement planning' strategies at Clause 13.02-1S require:

- *'Directing population growth and development to low risk locations, being those locations assessed as having a radiant heat flux of less than 12.5 kilowatts/square metre under AS 3959-2018 Construction of Buildings in Bushfire-prone Areas (Standards Australia, 2018).*
- *Not approving any strategic planning document, local planning policy, or planning scheme amendment that will result in the introduction or intensification of development in an area that has, or will on completion have, more than a BAL-12.5 rating under AS 3959-2018' (Clause 13.02-1S Greater Geelong Planning Scheme).*

All future buildings, regardless of whether they are a building class that requires construction to a BAL under the Victorian building regulations, will need to be sufficiently setback⁹ from classified vegetation so that radiant heat flux will be less than 12.5 kW/m². The setbacks required for Grassland, Shrubland, Woodland¹⁰ and Forest, based on the hazard assessment in Section 5 and determined using the simple Method 1 procedure of AS 3959:2018, are shown in Table 3. They have not been mapped as there are not currently any draft development plans against which to show any overlaps into the developable area.

The setbacks need to be measured from the edge of any classified vegetation. Classified vegetation outside of the precinct includes:

- Dry crops and pasture (classified as Grassland).

⁹ The setback distance is measured from the edge of the classified vegetation to the external wall of the building, or for parts of the building that do not have external walls (including carports, verandas, decks, landings, steps and ramps), to the supporting posts or columns. The following parts of a building are excluded:

- a) Eaves and roof overhangs.
- b) Rainwater and domestic fuel tanks.
- c) Chimneys, pipes, cooling or heating appliances or other services.
- d) Unroofed pergolas.
- e) Sun blinds (Standards Australia, 2020).

¹⁰ Woodland is not currently a significant vegetation type in the study area but is a possible outcome if the small patches of Plans Woodland are protected and expanded.

- Areas of trees planted in Avalon Airport (classified as Forest).
- Areas of freshwater wetland (classified as Grassland or Shrubland), unless comprising reliably open water or wet areas with little or no vegetation (n.b. seasonally inundated wetlands that may be dry and vegetated during the fire danger period will comprise classified vegetation).

Conservation reserves and drainage reserves within the precinct could comprise a range of classified vegetation, including:

- Woodland (e.g. containing the patches of EVC 55 Plains Woodland found in and around the precinct).
- Grassland (e.g. predominantly containing remnant EVC 132 Plains Grassland or introduced grasses).
- Shrubland (e.g. if some areas of wetland are considered hazardous).

The size of the reserves, their setback from buildings and other patches of classified vegetation, and how the naturally occurring and/or planted vegetation within them is managed during the fire danger period, will determine whether they are excludable as non-hazardous vegetation

Classified vegetation outside of the precincts all in the 'All upslopes and flat land' slope class, whilst vegetation retained within the precinct, such as along drainage lines, could be in the 'Downslope >0-5°' slope class.

The setbacks would need to comprise low threat vegetation or non-vegetated areas.

Note that setbacks are not required from areas of unmanaged vegetation that meet one or more of the exclusion criteria for low threat vegetation (see Section 5.1.4), including:

- Single areas of vegetation less than 1 ha in area and at least 100 m from other areas of classified vegetation.
- Multiple areas less than 0.25 ha (2,500 m²) in area that are at least 20 m from a building or each other.
- Strips of vegetation less than 20 m wide that are at least 20 m from a building, other strips or any other area of classified vegetation.

Table 3 - Building setbacks for BAL-12.5.

Slope class	Vegetation	BAL-12.5 setback distance (defendable space)
All upslopes and flat land	Grassland	19 m
	Shrubland	19 m
	Woodland	33 m
	Forest	48 m
Downslope >0-5°	Grassland	22 m

Slope class	Vegetation	BAL-12.5 setback distance (defendable space)
	Shrubland	22 m
	Woodland	41 m
	Forest	57 m

6.1.2 Interface design

The low threat setback can be achieved by a combination of:

- Setback of buildings within adjacent lots
- A perimeter road around the precinct or around an internal reserve
- A managed low threat strip within or adjacent to the reserve.

These options are illustrated for a residential setting in Figure 10, but the principles can apply to a commercial/industrial setting such as the Greater Avalon Employment Precinct.



Figure 10 – An example of a perimeter road, managed parkland and wetland with fringing vegetation.
File photograph from Ballarat.

6.1.3 Perimeter roads

Perimeter roads are a useful bushfire protection measure to provide a firm edge to the urban area and to facilitate property protection and fire fighting (see Figure 11) and can be included

within the low threat setback area. Perimeter roads should meet the guidelines detailed in *Vehicle Access and Water Supply Requirements in Residential Developments* (CFA, 2022b).

For the Western section of the precinct, Avalon Road provides an existing perimeter road along the western boundary and the Princes Freeway along the northern. The southern and eastern boundaries are less critical as they abut low threat wetlands and Avalon Airport respectively.

For the Northern section, the Princess Freeway provides a perimeter road to the north and west, and Beach Road to the south. To the east are the irrigated crops in the Western Treatment Plant, but we recommend consideration be given to providing a perimeter road along the eastern boundary, which would insure against any change of management that resulted in the vegetation becoming hazardous.

Perimeter roads should also be considered for any substantial conservation or drainage reserves to be created within the precinct and could provide most or all of the low threat setback required in response to Grassland or Shrubland. If the perimeter roads are to form part of the low threat setback, the roadsides will need to be maintained in a low threat state.

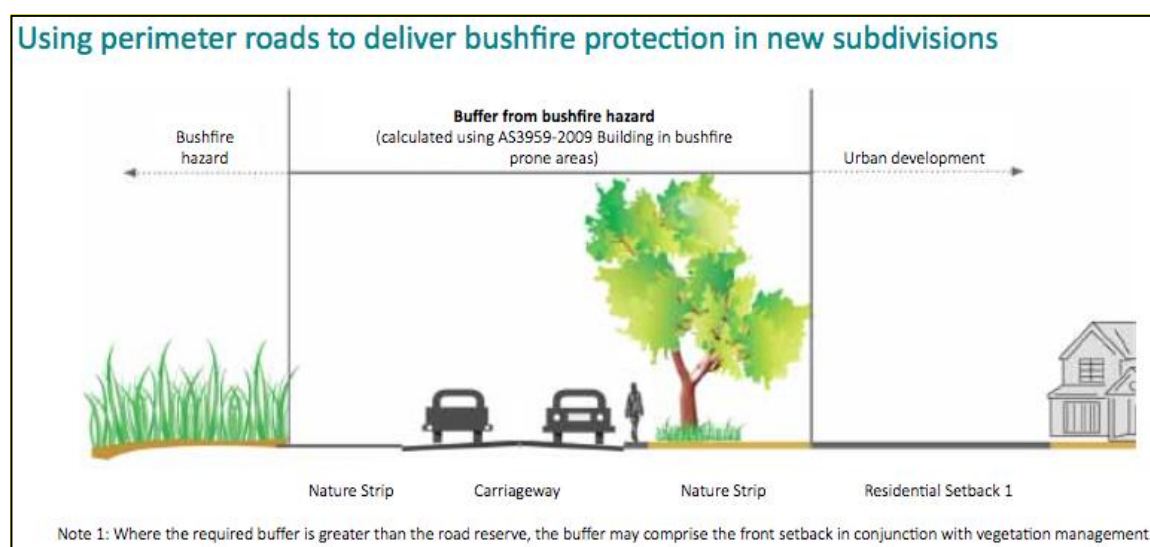


Figure 11 - Illustration of a perimeter road to provide required development setbacks (DELWP, 2015).

6.2 Bushfire Attack Level (BAL) construction standard

6.2.1 Industrial or commercial buildings

Industrial and commercial buildings are typically not of a building class that is required by the Victorian building regulations to be built to a BAL construction standard¹¹. Thus, whilst they need

¹¹ Unless they are covered by the Bushfire Management Overlay (BMO) and trigger the requirement for a planning permit.

to be sufficiently setback from classified vegetation (see Section 6.1), they will not need to be built to a BAL.

6.2.2 Accommodation buildings

We understand that the precinct is not intended for residential use. If, however, any Class 1, 2 or 3 buildings are to be built, they will need to be setback the required distance from classified vegetation (see Section 6.1.1) and constructed to a minimum BAL-12.5 in accordance with AS 3959:2018 *Construction of buildings in bushfire prone areas* or, for Class 1 buildings and associated decks only, the NASH Standard – *Steel Framed Construction in Bushfire Areas* (NASH, 2021).

6.2.3 Certain Class 9 buildings

The National Construction Code (NCC) 2022 (ABCB, 2023) requires additional bushfire protection measures for certain Class 9 buildings; namely Class 9a healthcare, Class 9b early childhood centres, primary or secondary schools, Class 9c residential care and a Class 4 part of a building associated with the nominated Class 9 uses.

If these types of buildings are constructed in the future, Specification 43 of NCC 2022 applies as a 'deemed-to-satisfy' pathway for buildings with a BAL rating of no more than BAL-12.5.

Specification 43 prescribes minimum standards for:

- S43C1 Scope
- S43C2 Separation from classified vegetation
- S43C3 Separation between buildings
- S43C4 Separation from allotment boundaries and carparking areas
- S43C5 Separation from hazards
- S43C6 Non-combustible path around building
- S43C7 Access pathways
- S43C8 Exposed external areas
- S43C9 Internal tenability
- S43C10 Building envelope
- S43C11 Supply of water for fire fighting purposes
- S43C12 Emergency power supply
- S43C13 Signage
- S43C14 Vehicular access.

The ability of a Class 9 building to comply with S43C2, S43C3, S43C4, S43C8 and S43C14 may be influenced by the precinct design and for building compliance additional analysis and a performance-solution may be required for this type of development.

6.3 Access and egress

The *Design Guidelines: Settlement Planning at the Bushfire Interface* (DELWP, 2020a) list the elements of an effective road network as:

- Ensuring the spacing of roads leading away from the hazard are no more than 120 m apart on average.
- Designing road widths to meet planning scheme requirements and those of the relevant fire authority.
- Providing multiple roads leading away from the hazard edge.
- Ensuring travel to and from a location is not alongside a bushfire hazard and providing multiple access and egress routes within developed areas to minimise the use of perimeter roads during bushfire.
- Effectively connecting roads to the broader road network within the settlement (DELWP, 2020a).

The precinct is adjacent to the Princes Freeway and multiple existing roads connect to it (Avalon Road, Pousties Road and Point Wilson Road. Beach Road and Dandos Road are existing east-to-west roads that link the Western and Northern sections of the precinct and Avalon Airport.

Future subdivisions should be designed to achieve the relevant characteristics outlined above¹² and provide adequate emergency vehicle access (see CFA, 2022b). This requirement should be included in the DPO intended to guide development in the precinct.

6.4 Vegetation management within the precinct

Vegetation on private property throughout the precinct should be maintained in a low threat state. This requirement should be included in the DPO intended to guide development in the precinct.

Table 6 to Clause 53.02-5 in the Greater Geelong planning scheme can be used as a guide to managing vegetation in a low threat condition:

- Grass must be short cropped and maintained during the declared fire danger period.
- All leaves and vegetation debris must be removed at regular intervals during the declared fire danger period.
- Within 10 metres of a building, flammable objects must not be located close to the vulnerable parts of the building.
- Plants greater than 10 centimetres in height must not be placed within 3 metres of a window or glass feature of the building.
- Shrubs must not be located under the canopy of trees.

¹² The first dot point relating to the frequency of roads leading away from the hazard is intended for residential areas and may be more than is required for an industrial/commercial area.

- Individual and clumps of shrubs must not exceed 5 square metres in area and must be separated by at least 5 metres.
- Trees must not overhang or touch any elements of the building.
- The canopy of trees must be separated by at least 5 metres.
- There must be a clearance of at least 2 metres between the lowest tree branches and ground level (Clause 53.02-5, Greater Geelong Planning Scheme).

Note these requirements apply to defensible space in higher hazard locations covered by the BMO and could be varied within the Greater Avalon Employment Precinct.

6.5 Bushfire Site Management Plan

If the precinct is to be developed in stages, a Bushfire Site Management Plan or similar could be required to ensure that undeveloped land adjacent to areas being developed is managed in a low threat state (i.e. grass cut to less than 100 mm in height during the declared Fire Danger Period) until it in turn is rendered permanently low threat through urban development. This requirement should be included in the DPO intended to guide development in the precinct.

6.6 Excision of areas from the BPA

It is likely that as development progresses, land within the Greater Avalon Employment Precinct will become eligible to be excised from the BPA. DTP review and excise areas from the BPA approximately every 6 months, particularly in growth areas where the hazard is removed as urban development occurs.

Areas that may be eligible for excision as urban development progresses are:

- Land more than 60 m from classified Grassland, e.g. from the pasture and cropping outside precinct or grassland drainage or conservation reserves; and
- Land more than 300 m from classified Forest or Woodland, e.g. from plantings in Avalon Airport.

6.7 Fire service delivery

We understand VPA have had discussion with FRV regarding reserving land within the precinct for a new fire station.

6.8 Incorporating bushfire protection measures in the DPO

The application of the DPO is intended to address bushfire risk early in the planning process, as an alternative to stipulating bushfire protection measures in a Precinct Structure Plan, rather than these measures being determined at the planning permit stage for individual development applications.

The bushfire protection measure requirements can be incorporated into the DPO as a sub-section titled 'Bushfire Management Requirements'. The following content is recommended:

- Direction that buildings are to be setback from classified vegetation external to and within the precinct to ensure radiant heat flux on buildings will be less than 12.5 kW/m² (see Section 6.1).
- Setback distances from Table 3 of this report presented in a table and/or shown on a map/s.
- Provision of perimeter roads on the interface with areas of enduring bushfire hazard external to and within the precinct. The perimeter road can form part of the low threat setback (see Section 6.1.3).
- Consideration be given to perimeter roads or other reliably low threat area abutting the irrigated areas of the Western Treatment Plant and the wetlands to the south, noting that a conservation reserve may abut the wetland to the south and a linear park may abut the Western Treatment Plant.
- Provision of multiple egress routes into the centre of the precinct, away from the bushfire hazard interface (see Section 6.3).
- Roads are to comply with fire service requirements for emergency access/egress.
- Provision of water for fire fighting via a reticulated hydrant network, supplemented by static water supplies if required by NCC 2022 for the class and size of building (see Section 6.3).
- Inclusion of bushfire in the emergency management plans for businesses exposed to a bushfire hazard.
- Requirement for subdivision applications to include a Bushfire Site Management Plan (see Section 6.5) identifying and confirming:
 - The staging of development.
 - Management of interim bushfire hazard setbacks (i.e. grass to be cut to less than 100 mm in height until land is rendered permanently low threat through urban development).
- Vegetation on private property to be maintained in a low threat condition (see Section 6.4).

7 Clause 13.02-1S Bushfire Planning

The following sub-sections provide a summary response about how development in the Greater Avalon Employment Precinct can respond to the objectives and strategies for bushfire safety in the Policy Planning Framework at Clause 13.02-1S.

7.1 Protection of human life strategies

Clause 13.02-1S requires that the priority be given to protection of human life.

Prioritising the protection of human life over all other policy considerations

As identified in Section 5.5, the Greater Avalon Employment Precinct is in a low-moderate bushfire risk location. The protection of human life can be prioritised by:

- Ensuring future buildings are located where a BAL-12.5 construction standard (or BAL-LOW) can be achieved (i.e. providing setbacks for future buildings from unmanaged vegetation, such that radiant heat impacting upon the buildings can be expected to be below 12.5 kW/m²).
- Applying the existing building regulations for construction in a BPA.
- Providing access and water supplies for fire fighting.
- Ensuring businesses exposed to a bushfire hazard develop a BEMP commensurate to the risk and appropriate to their business operations.

Directing population growth and development to low risk locations and ensuring the availability of, and safe access to, areas where human life can be better protected from the effects of bushfire.

If future buildings are setback sufficiently from any hazardous vegetation such that they achieve a BAL-12.5 rating, or lower, the risk can be deemed to be acceptably mitigated.

The nearest *lowest* risk location is the urban-residential area of Lara to the west of the precinct that is not in the BPA (see Map 1).

Reducing the vulnerability of communities to bushfire through consideration of bushfire risk in decision-making at all stages of the planning process

This report provides the basis for incorporating bushfire risk into decision making associated with planning for development in the precinct.

The CFA consider that community resilience to bushfire will be strengthened (and hence, presumably, vulnerability to bushfire will be reduced) when a strategic planning proposal demonstrates that Clause 13.02-1S strategies have been applied, and where a proposal takes advantage of existing settlement patterns so that new development will not expose the community to increased risk from bushfire.

The CFA provide principles to respond to Clause 13.02-1S including that settlement planning decisions should:

- Direct development to locations of lower bushfire risk.
- Carefully consider development in locations where there is significant bushfire risk that cannot be avoided.
- Avoid development in locations of extreme bushfire risk.
- Avoid development in areas where planned bushfire protection measures may be incompatible with other environmental objectives, such as the Ramsar listed wetlands.

It is considered that development of the Greater Avalon Employment Precinct can appropriately implement the strategies in Clause 13.02-1S that aim to prioritise protection of human life and will, therefore, meet the CFA strategic planning principles for bushfire.

7.2 Bushfire hazard identification and assessment strategies

Clause 13.02-1S requires that the bushfire hazard be identified, and appropriate risk assessment be undertaken.

Applying the best available science to identify vegetation, topographic and climatic conditions that create a bushfire hazard.

This report identifies the hazard in accordance with the commonly accepted methodologies of AS 3959:2018 and, as appropriate, additional guidance provided in *Planning Practice Note 64 Local planning for bushfire protection* (DELWP, 2015), *Planning Advisory Note 68 Bushfire State Planning Policy Amendment VC140* (DELWP, 2018) and *Planning Permit Applications – Bushfire Management Overlay*, Technical Guide (DELWP, 2017).

The type and extent of (hazardous) vegetation within and around the precinct has been identified. Classification is based on the anticipated long-term state of the vegetation, EVC mapping, aerial imagery, site assessment, published guidance on vegetation assessment for bushfire purposes and experience with the fuel hazard posed by the vegetation types that occur within the region.

Publicly available contour data for the area was accessed which, along with the site assessment, determined that the topography is benign from a bushfire perspective.

In relation to climatic conditions and fire weather, the AS 3959:2018 default FFDI 100/GFDI 130 benchmark used in the Victorian planning and building system, has been applied as discussed in Section 5.4.

Considering the best available information about bushfire hazard including the map of designated bushfire prone areas prepared under the Building Act 1993 or regulations made under that Act.

The extent of BPA coverage has been considered (see Section 4.2) and is shown in Map 4. This is based on the most recent BPA mapping for the state.

Applying the Bushfire Management Overlay in planning schemes to areas where the extent of vegetation can create an extreme bushfire hazard.

BMO coverage reflects BMO mapping introduced into the Greater Geelong Planning Scheme by amendment GC13, which was gazetted on 3rd October 2017 and no part of the precinct is affected.

Considering and assessing the bushfire hazard on the basis of:

- ***Landscape conditions - meaning the conditions in the landscape within 20 kilometres and potentially up to 75 kilometres from a site;***
- ***Local conditions - meaning conditions in the area within approximately 1 kilometre from a site;***
- ***Neighbourhood conditions - meaning conditions in the area within 400 metres of a site; and***
- ***The site for the development.***

The hazard has been assessed and described at the regional, municipal and local (site and neighbourhood) scale (see Section 5).

At the local scale, the assessment classified vegetation and topography within a 150 m assessment zone around the precinct.

At the landscape scale a 10 km radius of the precinct has been applied (see Map 4) in accordance with guidance about assessing risk for planning scheme amendments provided in the Planning Advisory Note 68 (DELWP, 2018) and Planning Practice Note 64 (DELWP, 2015).

Consulting with emergency management agencies and the relevant fire authority early in the process to receive their recommendations and implement appropriate bushfire protection measures.

The Western section of the precinct is in the FRV district, whilst the Northern section is in the CFA area. CFA have reviewed a draft version of this report and expressed support for the approach being taken. FRV are expected to provide comments during public consultation.

Ensuring that strategic planning documents, planning scheme amendments, planning permit applications and development plan approvals properly assess bushfire risk and include appropriate bushfire protection measures.

DTP and CFA advisory and practice notes, Clause 13.02-1S and the building regulations invoked by the BPA coverage, specify the general requirements and standards for assessing the risk. These have been used in this report as appropriate and bushfire protection measures have been identified commensurate with the risk. Relevant regional

bushfire plans have been identified, reviewed and incorporated into this assessment as appropriate.

Not approving development where a landowner or proponent has not satisfactorily demonstrated that the relevant policies have been addressed, performance measures satisfied or bushfire protection measures can be adequately implemented.

The risk can be deemed to be acceptably mitigated such that development can proceed if the objectives and strategies of Clause 13.02-1S are successfully implemented as identified in this report.

7.3 Settlement planning strategies

Clause 13.02-1S requires that settlement planning must strengthen the resilience of settlements and communities and prioritise protection of human life.

Directing population growth and development to low risk locations, being those locations assessed as having a radiant heat flux of less than 12.5 kilowatts/square metre under AS 3959-2018 Construction of Buildings in Bushfire-prone Areas (Standards Australia, 2018).

The applicable distances for buildings to be setback from classifiable vegetation, such that RHF is calculated to be below 12.5 kW/m² have been identified. Taking into consideration the assessment of landscape risk, implementation of these can be deemed to acceptably mitigate the risk.

Ensuring the availability of, and safe access to, areas assessed as a BAL-LOW rating under AS 3959-2018 Construction of Buildings in Bushfire-prone Areas (Standards Australia, 2018) where human life can be better protected from the effects of bushfire.

The nearest existing lowest risk locations, where BAL-LOW can be achieved, are the urban areas of Lara to the west of the precinct that are not a designated BPA (see Map 4). It is likely that upon completion of the proposed development of the Greater Avalon Employment Precinct areas within the precinct would also be assessed as BAL-LOW.

Ensuring the bushfire risk to existing and future residents, property and community infrastructure will not increase as a result of future land use and development.

Achieving no net increase in risk to existing and future residents, property and community infrastructure, through the implementation of bushfire protection measures and where possible reduce bushfire risk overall.

There will be no increase in risk to existing residents or community infrastructure if:

- Future buildings are setback from hazardous vegetation such that RHF is calculated to be below 12.5 kW/m², an appropriate water supply for fire fighting is provided via a reticulated hydrant system (supplemented by static water

supplies if required under NCC 2022), and appropriate access/egress for emergency vehicles and workers is provided via a conventional road network.

- It is ensured that any hazardous vegetation retained or re-established, does not create an increase in the hazard exposure for neighbouring properties.

Assessing and addressing the bushfire hazard posed to the settlement and the likely bushfire behaviour it will produce at a landscape, settlement, local, neighbourhood and site scale, including the potential for neighbourhood-scale destruction.

This report appropriately assesses and addresses the risk at a range of scales.

Assessing alternative low risk locations for settlement growth on a regional, municipal, settlement, local and neighbourhood basis.

No alternative low risk development locations have been identified or assessed as part of this study. It is noted that development of the Greater Avalon Employment Precinct seems consistent with the Avalon Corridor Strategy (Wyndham City and City of Greater Geelong, 2022). The strategy identifies bushfire as a risk to the Avalon corridor and recommends assessment on a case-by-case basis.

Not approving any strategic planning document, local planning policy, or planning scheme amendment that will result in the introduction or intensification of development in an area that has, or will on completion have, more than a BAL-12.5 rating under AS 3959-2018

If the setback distances from any hazardous vegetation, as identified in this report, are implemented, then construction can achieve a BAL rating not exceeding BAL-12.5.

In the future, parts of the Greater Avalon Employment Precinct may be excised from the BPA, in which case buildings in non-BPA parts of the precinct would be rated BAL-LOW.

7.3.1 Areas of high biodiversity conservation value

Ensure settlement growth and development approvals can implement bushfire protection measures without unacceptable biodiversity impacts by discouraging settlement growth and development in bushfire affected areas that are of high biodiversity conservation value

A Native Vegetation Precinct Plan has been prepared for the precinct that identifies areas to be set aside in conservation reserves.

There are no apparent biodiversity impacts associated with the findings of this bushfire assessment.

7.3.2 Use and development control in a Bushfire Prone Area

Clause 13.02-1S requires that *'In a bushfire prone area designated in accordance with regulations made under the Building Act 1993, bushfire risk should be considered when assessing planning applications for the following uses and development:*

- *Subdivisions of more than 10 lots.*
- *Accommodation.*
- *Child care centre.*
- *Education centre.*
- *Emergency services facility.*
- *Hospital.*
- *Indoor recreation facility.*
- *Major sports and recreation facility.*
- *Place of assembly.*
- *Any application for development that will result in people congregating in large numbers'* (Clause 13.02-1S, Greater Geelong Planning Scheme).

It further states that:

'When assessing a planning permit application for the above uses and development:

- *Consider the risk of bushfire to people, property and community infrastructure.*
- *Require the implementation of appropriate bushfire protection measures to address the identified bushfire risk.*
- *Ensure new development can implement bushfire protection measures without unacceptable biodiversity impacts'* (Clause 13.02-1S, Greater Geelong Planning Scheme).

Future development applications in the BPA, can achieve acceptable bushfire safety if:

- Setbacks for future development from classified vegetation are provided such that RHF is calculated to be below 12.5 kW/m².
- Adequate access and egress for emergency management vehicles is provided by an internal road network, including where possible, a perimeter road between the urban area and unmanaged vegetation to assist property defence and fire fighting.
- A reliable water supply for fire fighting is provided via a reticulated hydrant system (supplemented by static water supplies if required under NCC 2022).

8 Conclusion

This study has assessed the bushfire hazard in and around the Greater Avalon Employment Precinct, in accordance with Clause 13.02-1S in the Greater Geelong Planning Scheme, the AS 3959:2018 methodology invoked by the Victorian planning and building system, and additional guidance provided in DTP planning and advisory notes, including:

- *Local planning for bushfire protection*, Planning Practice Note 64 (DELWP, 2015).

- *Planning Permit Applications – Bushfire Management Overlay*, Technical Guide (DELWP, 2017)
- *Bushfire State Planning Policy Amendment VC140*, Planning Advisory Note 68, (DELWP, 2018).

The precinct is partially a designated BPA but is not covered by the BMO.

The precinct is in a low bushfire risk landscape. In the directions from which a bushfire threat typically arises (north, north-west, west or south-west (Long, 2006)) the landscape is generally pastoral or comprises the existing urban area of Lara and Geelong.

If future buildings are setback sufficiently from any hazardous vegetation so that radiant heat flux will be 12.5 kW/m² or less, and bushfire protection measures are applied as outlined in this report (see Section 6.8) the bushfire risk can be deemed to be acceptably mitigated.

There are low risk urban-residential and township areas to the west of the precinct that are not in the BPA, and which offer a place of shelter from any bushfire that may occur.

The topography within and around the precinct is benign, with no significant changes in elevation or slopes that would significantly exacerbate the bushfire attack. For the purpose of determining setbacks from classified vegetation, the applicable slope class is 'All slopes and flat land' or 'Downslope >0°-5°'.

The type and extent of (hazardous) vegetation within and around the precinct has been identified and classified into AS 3959:2018 vegetation groups, based on EVC mapping, aerial imagery and site assessment. The classification is based on the current and likely future state of the vegetation. A patch of treed vegetation on Avalon Airport is classifiable as Forest, whilst areas of open pasture more than 100 mm in height and dry cropping, with less than 10% overstorey foliage cover, comprise Grassland.

The proposed conservation and drainage reserves could comprise classified Grassland, Woodland or Shrubland, depending on what vegetation is retained or re-established and how it is managed into the future. Urban development adjacent to these areas will be required to provide setbacks commensurate to reduce radiant heat flux on adjacent buildings to less than 12.5 kW/m².

Applicable setbacks are shown in the following table.

Slope class	Vegetation	BAL-12.5 setback distance (defendable space)
All upslopes and flat land	Grassland	19 m
	Shrubland	19 m
	Woodland	33 m

Slope class	Vegetation	BAL-12.5 setback distance (defendable space)
	Forest	48 m
Downslope >0-5°	Grassland	22 m
	Shrubland	22 m
	Woodland	41 m
	Forest	57 m

If parts of the Greater Avalon Employment Precinct are excised from the BPA as urban development permanently removes the bushfire hazard, no setbacks would be required.

Perimeter roads around the precinct and around conservation and drainage reserves containing classified vegetation should be incorporated where possible, to contribute to the setbacks for future development from any potentially hazardous vegetation, and to facilitate property protection and fire fighting. Much of the perimeter of the precinct is bounded by existing roads.

Good access and egress for emergency management vehicles and residents, in the event of a bushfire, can be achieved via a conventional road network with multiple links to the Princes Freeway via the existing interchanges.

A reliable water supply for fire fighting can be provided via a reticulated hydrant system.

The application of the existing bushfire controls in the planning and building system can be deemed adequate to address bushfire risk.

9 References

ABCB (2023) *Building Code of Australia, Volumes 1 and 2 of the National Construction Code (NCC)*, Australian Building Codes Board (ABCB). Available at <<http://abcb.gov.au/ncc-online/>>.

AFAC (2020) *Fire and emergency services and climate change*. Position Paper v1.0, 24th October. Australasian Fire and Emergency Service Authorities Council (AFAC), Available at <<https://knowledge.aidr.org.au/resources/emergency-management-and-climate-change/>>.

AFDRS (2022) *Fire Behaviour Index Technical Guide*. Australian Fire Danger Rating System (AFDRS) Version 3.0.

Blanchi R and Leonard J (2005) *Investigation of Bushfire Attack Mechanisms Resulting in House Loss in the ACT Bushfire 2003*. Bushfire Co-operative Research Centre, East Melbourne.

CFA (2022a) *Applying the Bushfire Hazard Landscape Assessment in a Bushfire Management Overlay*. Country Fire Authority, East Burwood.

CFA (2022b) *Design Requirements, Vehicle Access and Water Supply Requirements in Residential Developments*. Country Fire Authority, East Burwood.

CFA (2022c) *FSG LUP 006 Tank Connections Explained, Bushfire Management Overlay*. CFA Land Use Planning Fire Services Guideline. Country Fire Authority, Burwood East. Available at <<https://www.cfa.vic.gov.au>>.

CSIRO/BOM (2024) *State of the Climate 2024*, CSIRO and The Bureau of Meteorology (BOM), Commonwealth of Australia. Available at <<https://www.csiro.au/en/research/environmental-impacts/climate-change/state-of-the-climate>>.

DEECA (2025) *NatureKit online mapper*. Department of Energy, Environment and Climate Action, Melbourne. Available at <<https://maps2.biodiversity.vic.gov.au/Html5viewer/index.html?viewer=NatureKit>>.

DELWP (2015) *Local planning for bushfire protection*, Planning Practice Note 64. Department of Environment, Land, Water and Planning, Melbourne. Available at <<https://www.planning.vic.gov.au/publications/planning-practice-notes>>.

DELWP (2017) *Planning Permit Applications Bushfire Management Overlay* Technical Guide. Department of Environment, Land, Water and Planning, Melbourne. Available at <https://www.planning.vic.gov.au/__data/assets/pdf_file/0029/639506/Technical-Guide-Planning-Permit-Applications-Bushfire-Management-Overlay.pdf>.

DELWP (2018) *Bushfire State Planning Policy Amendment VC140*, Planning Advisory Note 68, Department of Environment, Land, Water and Planning, Melbourne. Available at <<https://www.planning.vic.gov.au/publications/planning-advisory-notes>>

DELWP (2019) *Bushfire Mapping Methodology and Criteria* Fact Sheet. Department of Environment, Land, Water and Planning, Melbourne. Available at <https://www.planning.vic.gov.au/__data/assets/pdf_file/0030/639507/Fact-sheet-Bushfire-mapping-methodology-and-criteria.pdf>.

DELWP (2020a) *Design Guidelines, Settlement Planning at the Bushfire Interface*. Department of Environment, Land, Water and Planning, Melbourne. Available at <<https://www.planning.vic.gov.au/policy-and-strategy/bushfire>>.

DELWP (2020b) *Barwon South West Bushfire Management Strategy*. Department of Environment, Land, Water and Planning, Melbourne. Available at <<https://www.safertogether.vic.gov.au/strategic-bushfire-management-planning>>.

DPCD (2012) *Regional Bushfire Planning Assessment – Grampians Region*. Department of Planning and Community Development, Melbourne.

EHP (2025) *Biodiversity Assessment for the Greater Avalon (Employment) Precinct, Avalon, Victoria*. Ecology & Heritage Partners, Ascot Vale.

FFMVic (2025) *Joint Fuel Management Program*. Forest Fire Management Victoria, Melbourne. Available at <<https://www.ffm.vic.gov.au/bushfire-fuel-and-risk-management/joint-fuel-management-program>>.

Greater Geelong MEMPC (2023) *Municipal Emergency Management Plan (MEMPC)* Version 1.0 April 23. Greater Geelong Municipal Emergency Management Planning Committee, Geelong.

Greater Geelong & Borough of Queenscliff (2023) *Greater Geelong and Borough of Queenscliff Joint Municipal Fire Management Sub-Plan*. Greater Geelong MEMPC Sub-committee and Borough of Queenscliff MEMPC Sub-committee, Geelong.

Greater Geelong Planning Scheme *Clause 12.03-1S River and riparian corridors, waterways, lakes, wetlands and billabongs*. Available at <<https://planning-schemes.app.planning.vic.gov.au/Greater%20Geelong/ordinance/12.03>>.

Greater Geelong Planning Scheme *Clause 13.01-1S Natural Hazards and Climate Change*. Available at <<https://planning-schemes.app.planning.vic.gov.au/Greater%20Geelong/ordinance/13.01-1S>>.

Greater Geelong Planning Scheme *Clause 13.02-1S Bushfire Planning*. Available at <<https://planning-schemes.app.planning.vic.gov.au/Greater%20Geelong/ordinance/13.02-1S>>.

Greater Geelong Planning Scheme *Clause 53.02 Bushfire Planning*. Available at <<https://planning-schemes.app.planning.vic.gov.au/Greater%20Geelong/ordinance/53.02>>.

Greater Geelong Planning Scheme *Clause 56.09 Utilities*. Available at <<https://planning-schemes.app.planning.vic.gov.au/Greater%20Geelong/ordinance/56.09>>.

Greater Geelong Planning Scheme *Clause 71.02-3 Integrated Decision Making*. Available at <<https://planning-schemes.app.planning.vic.gov.au/Greater%20Geelong/ordinance/71.02>>.

Long M (2006) A climatology of extreme fire weather days in Victoria. *Australian Meteorological Magazine*, **55**, 3-18.

March A, Holland M and Harwood A (2011) Planning for bushfire resilient urban design. *Proceedings of 5th State of Australian Cities National Conference*, 29 November – 2 December 2011, Melbourne.

NASH (2021) *NS 300 NASH Standard – Steel Framed Construction in Bushfire Areas 2021*. National Association of Steel-framed Housing Inc, Hartwell, Victoria.

Price O and Bradstock R (2013) Landscape scale influences of forest area and housing density on house loss in the 2009 Victorian bushfires. *PLOS ONE* **8(8)**.

Standards Australia (2020) *AS 3959:2018 Construction of buildings in bushfire-prone areas*, Including Amendment 3. Standards Australia, North Sydney.

Wyndham City and City of Greater Geelong (2022) *Avalon Corridor Strategy* November 2022. Wyndham City Council and Greater Geelong City Council,

10 Appendix: BAL construction standards

Bushfire Attack Level (BAL)	Risk Level	Construction elements are expected to be exposed to...	Comment
BAL-Low	VERY LOW: There is insufficient risk to warrant any specific construction requirements but there is still some risk.	No specification.	At 4 kW/m ² pain to humans after 10 to 20 seconds exposure. Critical conditions at 10 kW/m ² and pain to humans after 3 seconds. Considered to be life threatening within 1 minute exposure in protective equipment.
BAL-12.5	LOW: There is risk of ember attack.	A radiant heat flux not greater than 12.5 kW/m ² .	At 12.5 kW/m ² standard float glass could fail and some timbers can ignite with prolonged exposure and piloted ignition.
BAL-19	MODERATE: There is a risk of ember attack and burning debris ignited by windborne embers and a likelihood of exposure to radiant heat.	A radiant heat flux not greater than 19 kW/m ² .	At 19 kW/m ² screened float glass could fail.
BAL-29	HIGH: There is an increased risk of ember attack and burning debris ignited by windborne embers and a likelihood of exposure to an increased level of radiant heat.	A radiant heat flux not greater than 29 kW/m ² .	At 29 kW/m ² ignition of most timbers without piloted ignition after 3 minutes exposure. Toughened glass could fail.
BAL-40	VERY HIGH: There is a much increased risk of ember attack and burning debris ignited by windborne embers, a likelihood of exposure to a high level of radiant heat and some likelihood of direct exposure to flames from the fire front.	A radiant heat flux not greater than 40 kW/m ² .	At 42 kW/m ² ignition of cotton fabric after 5 seconds exposure (without piloted ignition).
BAL- FZ (Flame Zone)	EXTREME: There is an extremely high risk of ember attack and a likelihood of exposure to an extreme level of radiant heat and direct exposure to flames from the fire front.	A radiant heat flux greater than 40 kW/m ² .	At 45 kW/m ² ignition of timber in 20 seconds (without piloted ignition).

Adapted from Standards Australia (2020).